

HIGHLANDS SITE
DRAWINGS

DATE
August 8, 2022


FOR REVIEW

DRAWN BY
PA, TA

BASEMENT
MECHANICAL

APPROXIMATE DUCT LENGTHS

- INSULATED TRUNK IN ATTIC CRAWL SPACE- 30'
- 4" FOR BATHROOM EXHAUST LINES- 28'
- RISER IN OLD CHIMNEY CHASE - 11'

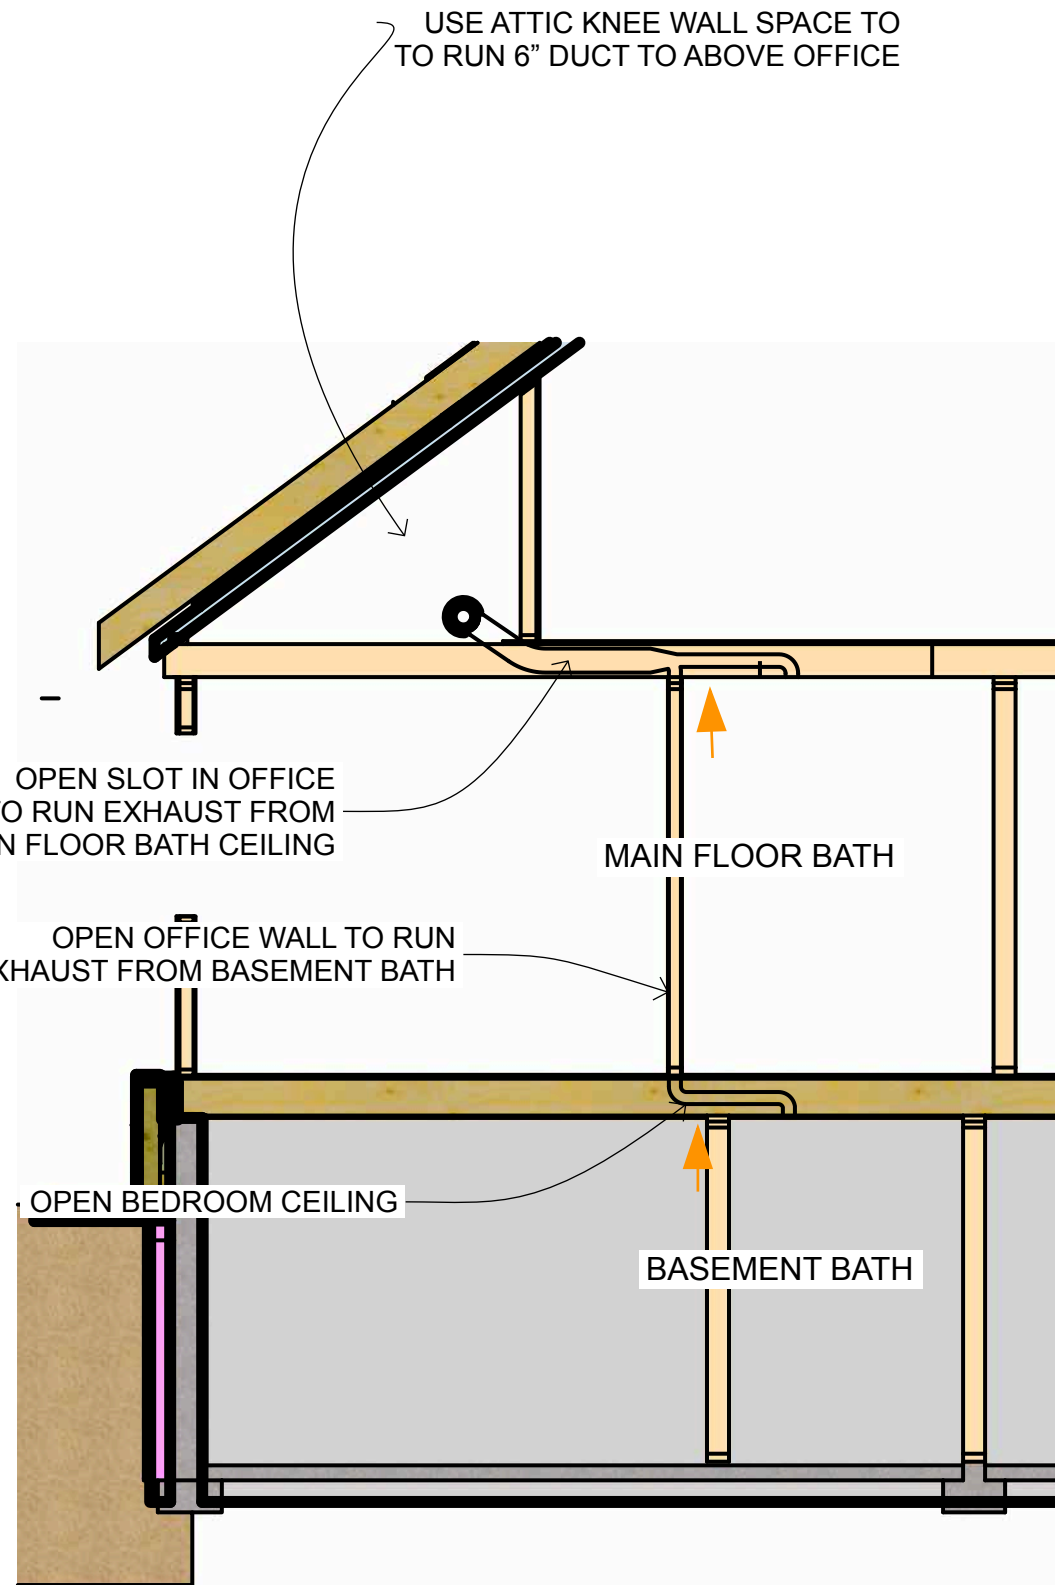

HIGHLANDS SITE
DRAWINGS

DATE
August 8, 2022

FOR REVIEW

DRAWN BY
PA, TA

HRV DUCTING