



SL MID R

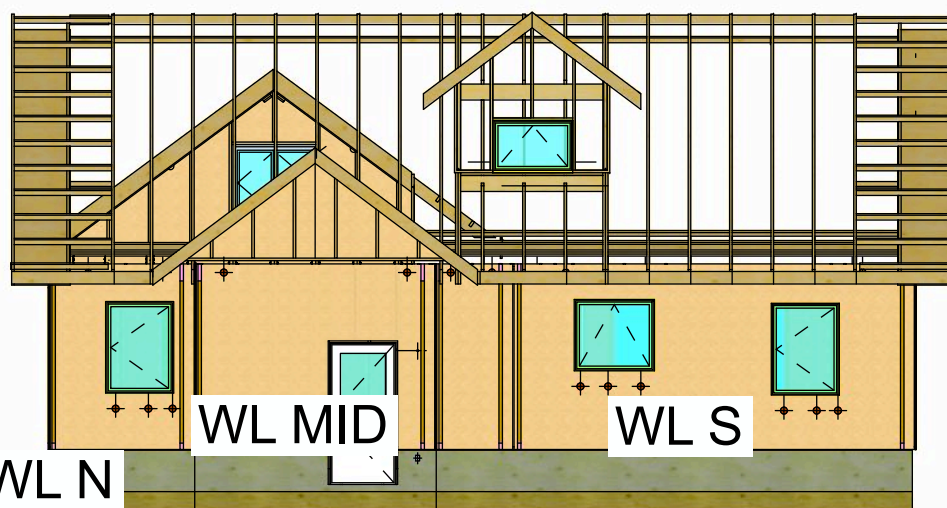

WL N

WL MID

WL S

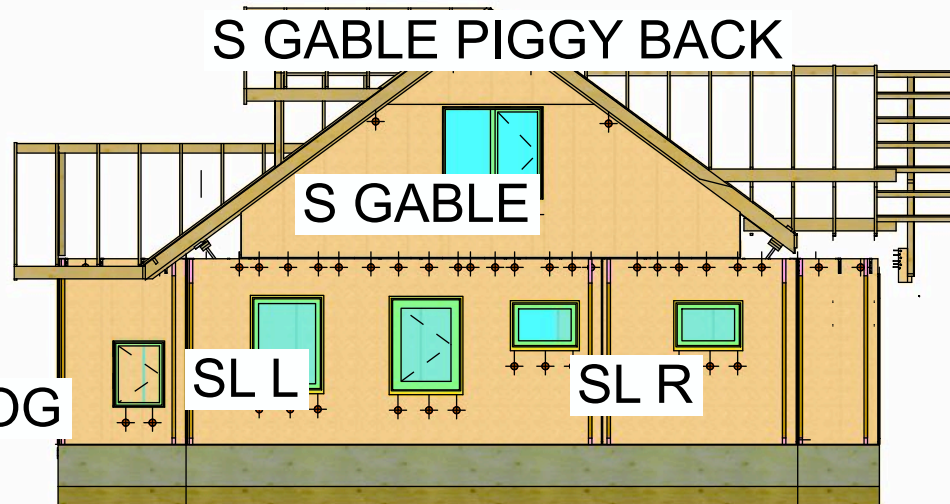

S GABLE PIGGY BACK


S GABLE

SL L

SL R

SL JOG

N GABLE PIGGY BACK

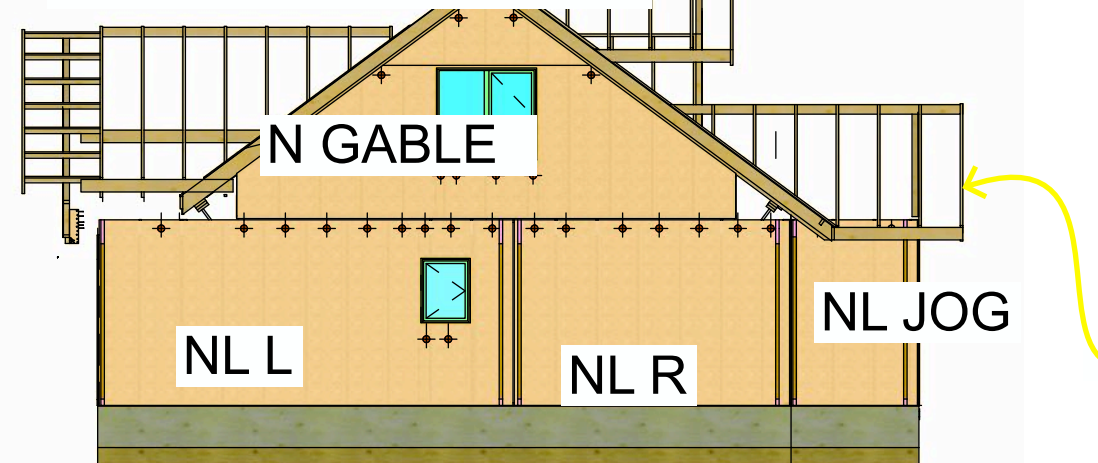

N GABLE

NL L

NL R

NL JOG

PAGE	ORDER	PANEL	LENGTH(FT)	HEIGHT (IN)
1		PANEL KEY		
2		EL SL	16.00	107.625
2		EL SR	8.33	107.625
3		EL N	17.25	98.75
4		WL S	23.25	107.625
5		WL N	7.10	107.625
5		WL MID	11.33	107.625
6		SL MID L	19.70	107.625
6		SL MID R	9.33	107.625
6		SL JOG	8.00	107.625
7		NL EL	20.00	107.625
7		NL ER	12.25	107.625
7		NL JOG	8.00	107.625
8		S GABLE	29.70	88.75
8		S GABLE PIGGY BACK		
9		N GABLE	29.70	88.75
9		N GABLE PIGGY BACK		
10		E GABLE	17.50	116
11		GABLE SHEATHING		
12		KOHLTECH WINDOW INSTALL DETAILS		

HIGHLANDS PANEL  
DRAWINGS

DATE  
June 3, 2022


FOR REVIEW

DRAWN BY  
PA, TA

PANEL KEY

**FRAME** Scale: 1/4" = 1'-0"

- NOTES:  
1. TOP AND BOTTOM PLATE TO BE LSL WHEN LENGTH EXCEEDS 14'  
2. FRAMING LUMBER TO BE #1&2 SPF OR EQUIVALENT  
3. STUDS SPACED @ 24" O.C. UNLESS OTHERWISE NOTED

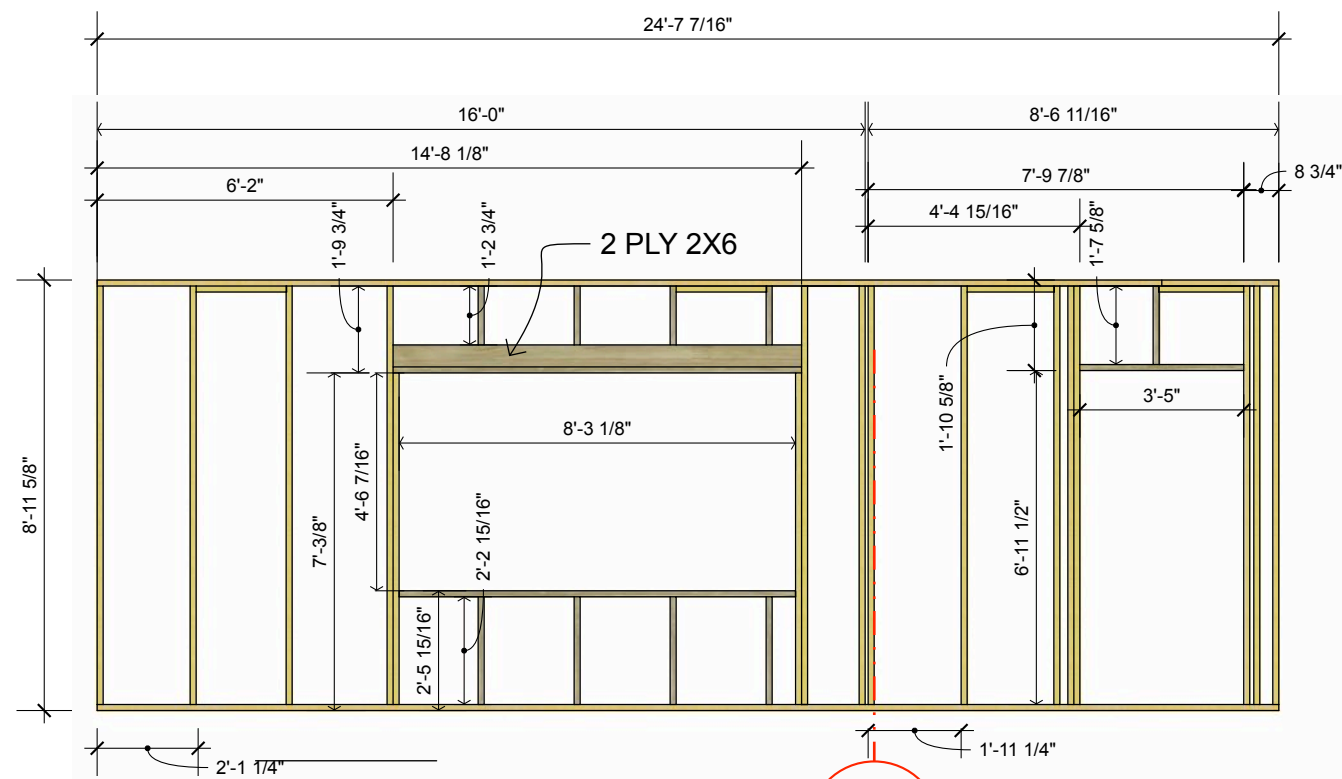


**EL SL**

3/4" PANEL SPLIT

**EL SR**

**SHEATHING** Scale: 1/4" = 1'-0"

- NOTES:  
1. SHEATHING 7/16" OSB OR 1/2" SPRUCE PLYWOOD  
2. FLUSH SHEATHING ON ALL EDGES EXCEPT WHERE NOTED  
3. HORIZONTAL GAP BETWEEN SHEATHING SHEETS TO BE MIN 3/8" AND CAN BE UP TO 1 1/2"  
4. 5" DIA CELLULOSE FILL AND LIFT HOLES TO BE CENTRED 5" DOWN FROM TOP OF WALL AND 9" DOWN FROM RO SILL.

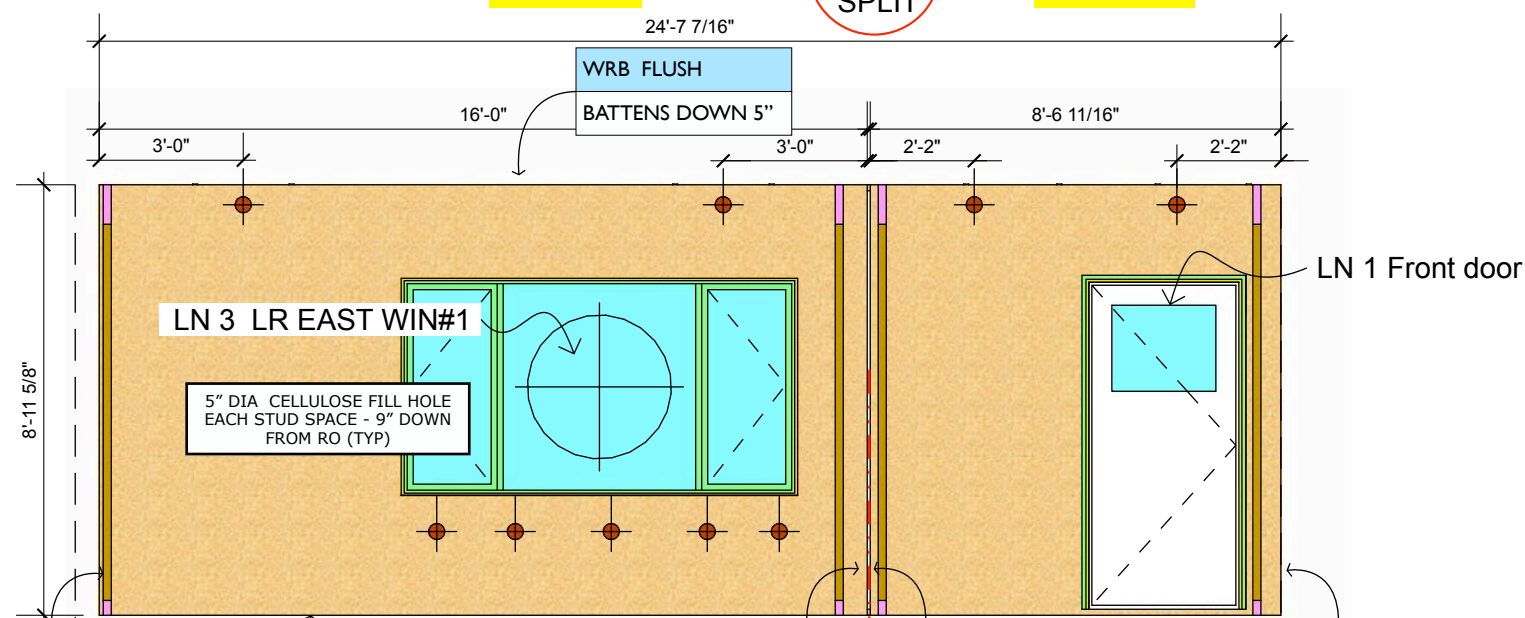

LN 3 LR EAST WIN#1  
5" DIA CELLULOSE FILL HOLE  
EACH STUD SPACE - 9" DOWN  
FROM RO (TYP)

LN 1 Front door

**EL SL**

3/4" PANEL SPLIT

**EL SR**

**WRB AND RAINSCREEN BATTENS**  
Scale: 1/4" = 1'-0"

- NOTES:  
1. WRB TO BE SIGA MAJVEST SEALED PER 1.2 ON DETAIL SET  
2. BATTENS AS REQ'D FOR SIDING PER DETAIL SET  
3. DO NOT INSTALL BATTENS OVER LIFTING HOLES OR BLOWING HOLES  
4. DO NOT CUT WRB AT CELLULOSE FILL HOLES  
5. STAPLE WRB LAP ALLOWANCE TO EXPOSED BATTENS AFTER SIDING

**HIGHLANDS PANEL DRAWINGS**

DATE  
June 3, 2022


**FOR REVIEW**

DRAWN BY  
PA, TA

**EL SL & SR**

**FRAME** Scale: 1/4" = 1'-0"


- NOTES:
1. TOP AND BOTTOM PLATE TO BE LSL WHEN LENGTH EXCEEDS 14'
  2. FRAMING LUMBER TO BE #1&2 SPF OR EQUIVALENT
  3. STUDS SPACED @ 24" O.C. UNLESS OTHERWISE NOTED

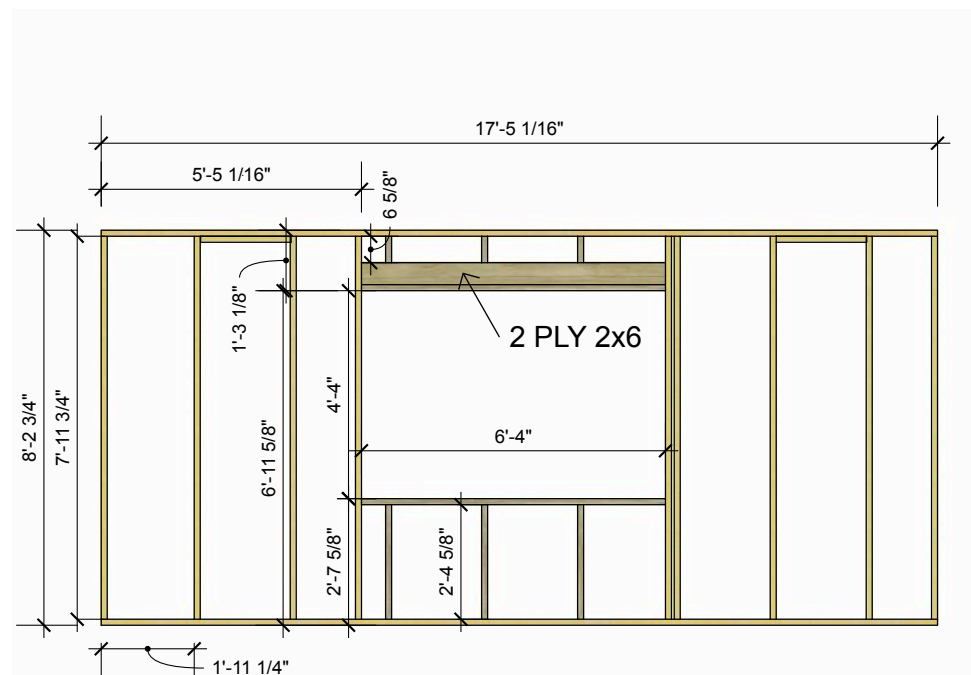

**EL N**

**SHEATHING** Scale: 1/4" = 1'-0"

- NOTES:
1. SHEATHING 7/16" OSB OR 1/2" SPRUCE PLYWOOD
  2. FLUSH SHEATHING ON ALL EDGES EXCEPT WHERE NOTED
  3. HORIZONTAL GAP BETWEEN SHEATHING SHEETS TO BE MIN 3/8" AND CAN BE UP TO 1 1/2"
  4. 5" DIA CELLULOSE FILL AND LIFT HOLES TO BE CENTRED 5' DOWN FROM TOP OF WALL AND 9" DOWN FROM RO SILL.

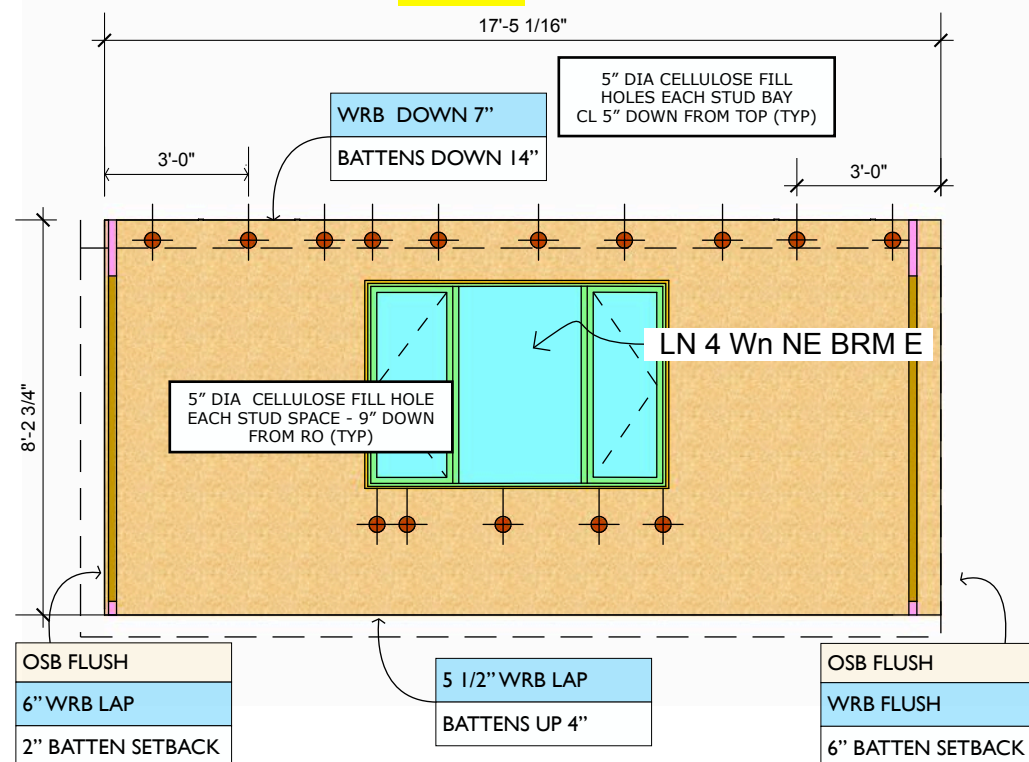

**EL N**

**WRB AND RAINDSCREEN BATTENS**  
Scale: 1/4" = 1'-0"

- NOTES:
1. WRB TO BE SIGA MAJVEST SEALED PER 1.2 ON DETAIL SET
  2. BATTENS AS REQ'D FOR SIDING PER DETAIL SET
  3. DO NOT INSTALL BATTENS OVER LIFTING HOLES OR BLOWING HOLES
  4. DO NOT CUT WRB AT CELLULOSE FILL HOLES
  5. STAPLE WRB LAP ALLOWANCE TO EXPOSED BATTENS AFTER SIDING


**HIGHLANDS PANEL DRAWINGS**

DATE  
June 3, 2022

**FOR REVIEW**

DRAWN BY  
PA, TA

EL NL

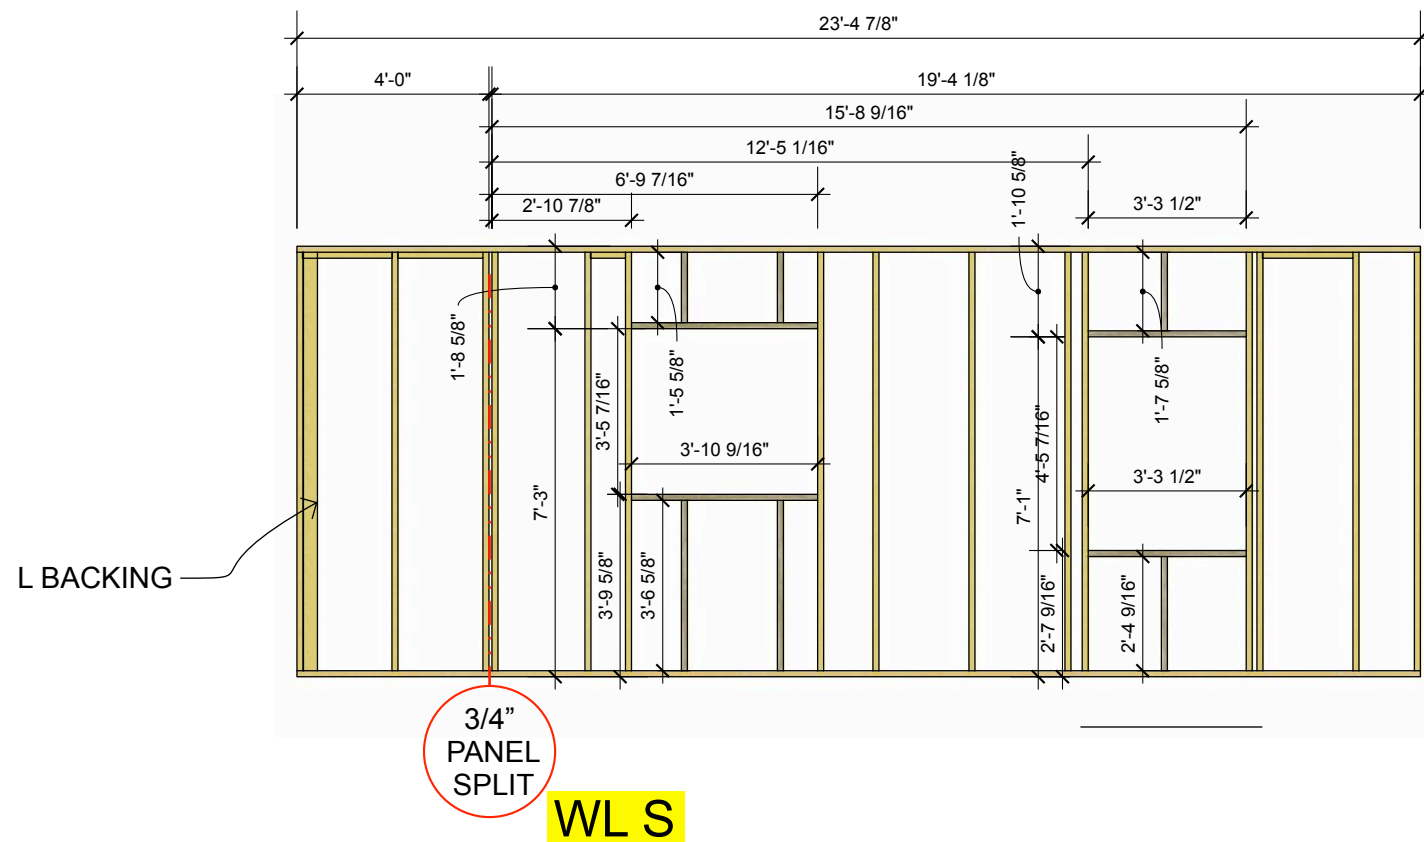

**SHEATHING** Scale: 1/4" = 1'-0"

- NOTES:  
1. SHEATHING 7/16" OSB OR 1/2" SPRUCE PLYWOOD  
2. FLUSH SHEATHING ON ALL EDGES EXCEPT WHERE NOTED  
3. HORIZONTAL GAP BETWEEN SHEATHING SHEETS TO BE MIN 3/8" AND CAN BE UP TO 1 1/2"  
4. 5" DIA CELLULOSE FILL AND LIFT HOLES TO BE CENTRED 5' DOWN FROM TOP OF WALL AND 9" DOWN FROM RO SILL.


**HIGHLANDS PANEL DRAWINGS**

DATE  
June 3, 2022

**FOR REVIEW**

DRAWN BY  
PA, TA

WLS

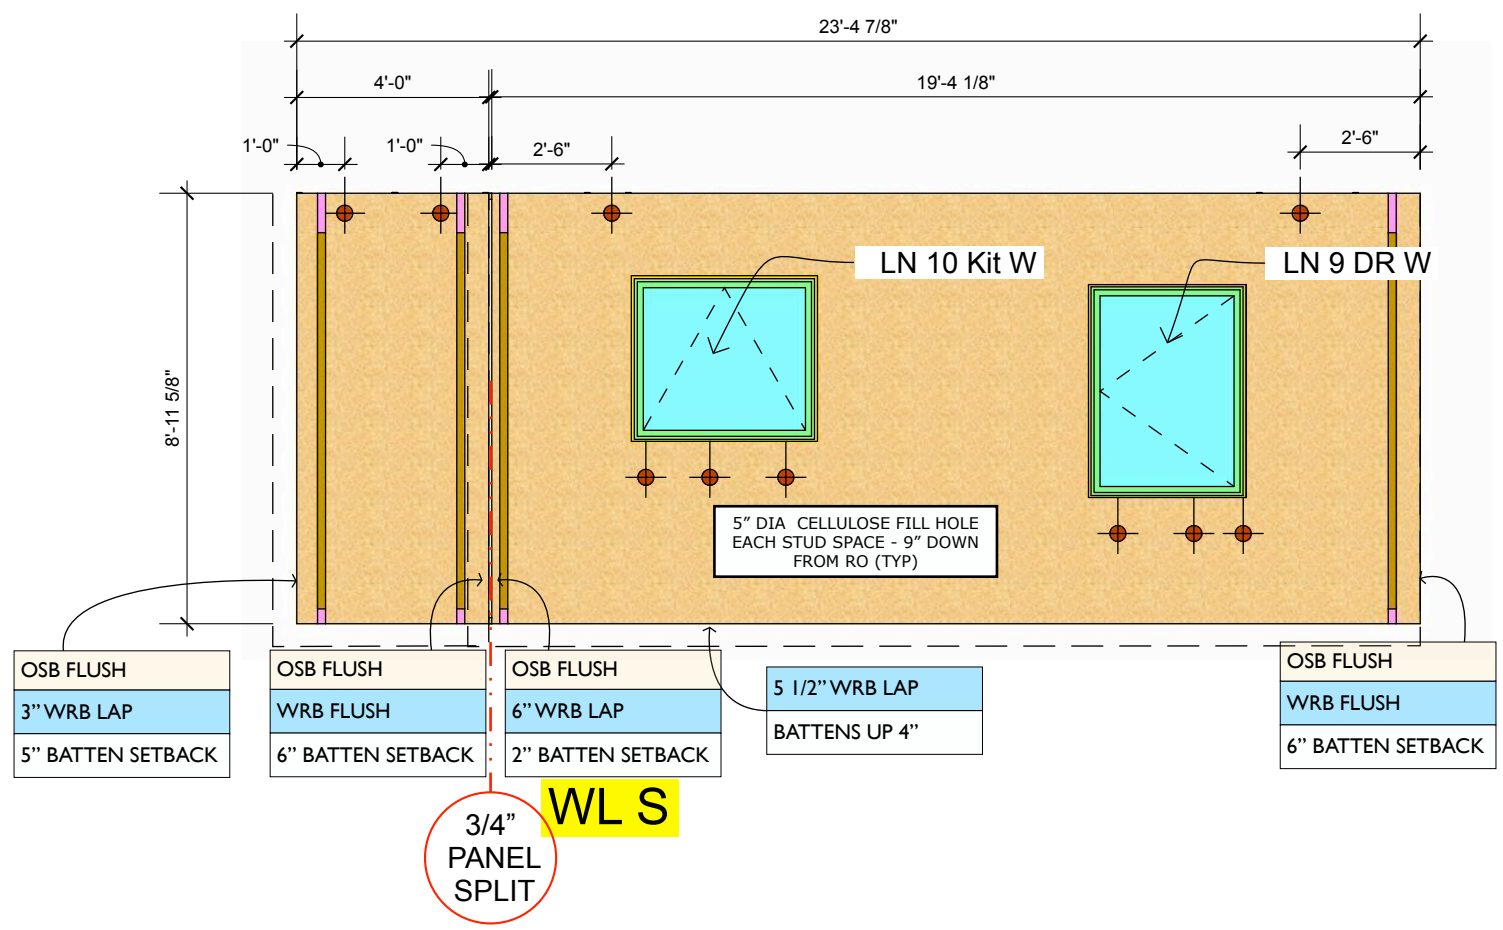

HIGHLANDS PANEL  
DRAWINGS

DATE  
June 3, 2022


FOR REVIEW

DRAWN BY  
PA, TA


WL N & WL MID

FRAME Scale: 1/4" = 1'-0"

- NOTES:
1. TOP AND BOTTOM PLATE TO BE LSL WHEN LENGTH EXCEEDS 14'
  2. FRAMING LUMBER TO BE #1&2 SPF OR EQUIVALENT
  3. STUDS SPACED @ 24" O.C. UNLESS OTHERWISE NOTED

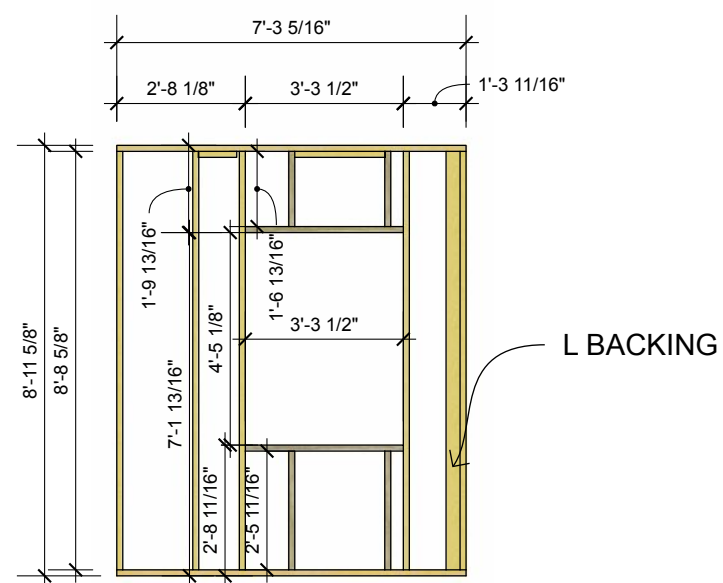


WL N

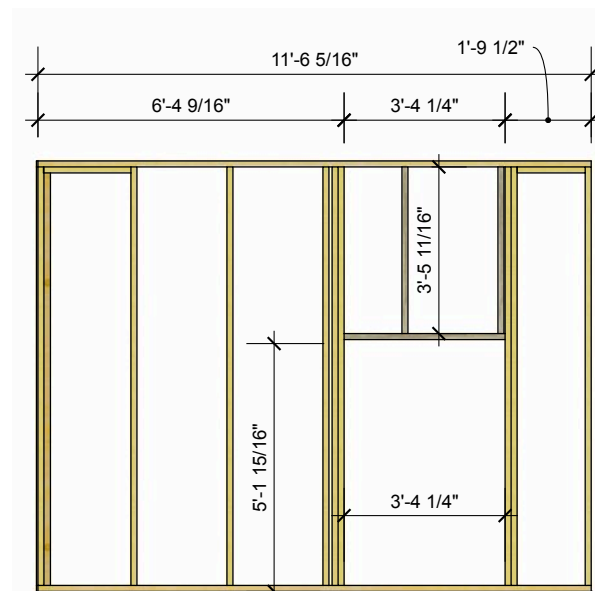


WL MID

SHEATHING Scale: 1/4" = 1'-0"

- NOTES:
1. SHEATHING 7/16" OSB OR 1/2" SPRUCE PLYWOOD
  2. FLUSH SHEATHING ON ALL EDGES EXCEPT WHERE NOTED
  3. HORIZONTAL GAP BETWEEN SHEATHING SHEETS TO BE MIN 3/8" AND CAN BE UP TO 1 1/2"
  4. 5" DIA CELLULOSE FILL AND LIFT HOLES TO BE CENTRED 5' DOWN FROM TOP OF WALL AND 9" DOWN FROM RO SILL.

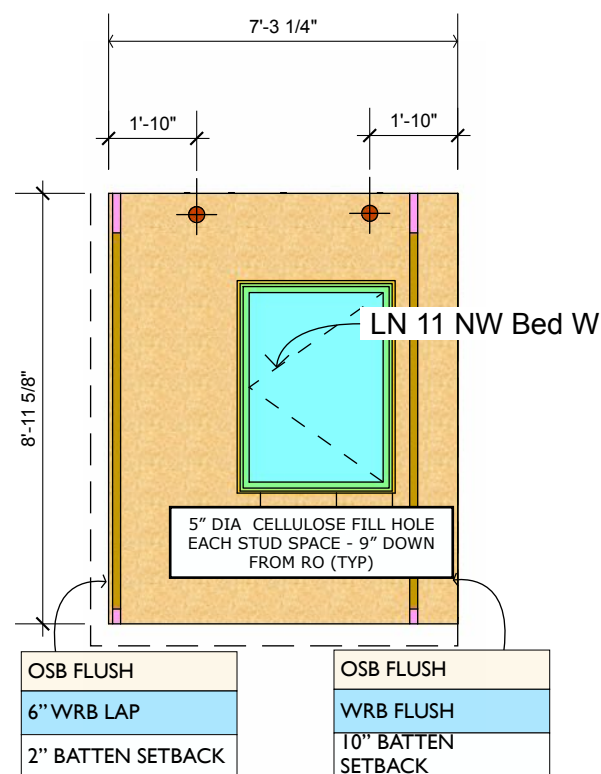


WL N

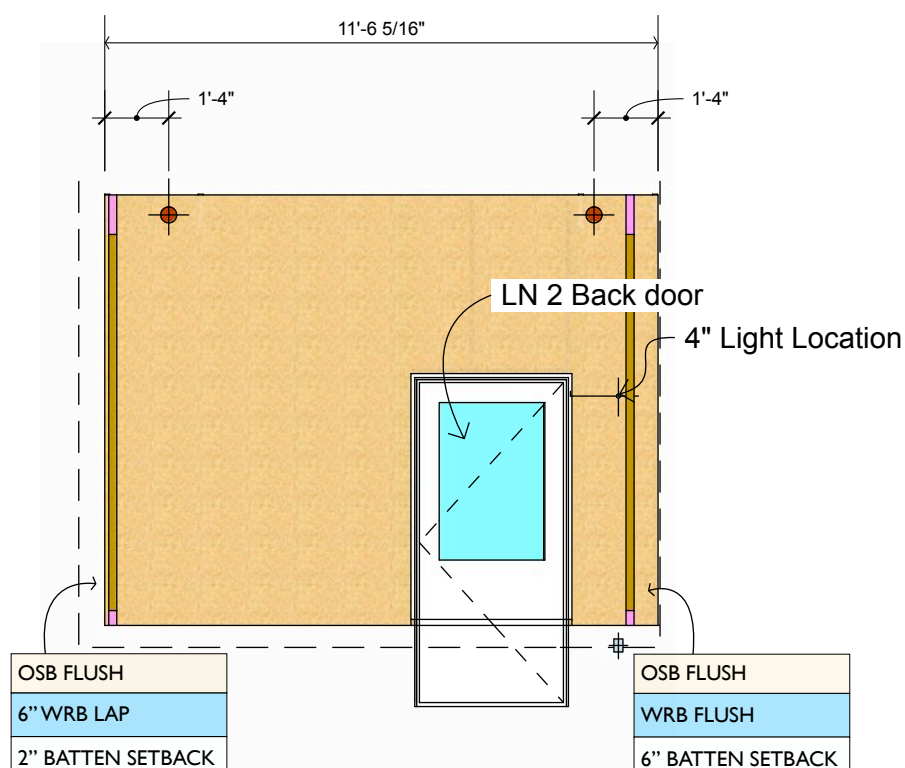

WL MID

WRB AND RAINSCREEN BATTENS Scale: 1/4" = 1'-0"


- NOTES:
1. WRB TO BE SIGA MAJVEST SEALED PER 1.2 ON DETAIL SET
  2. BATTENS AS REQ'D FOR SIDING PER DETAIL SET
  3. DO NOT INSTALL BATTENS OVER LIFTING HOLES OR BLOWING HOLES
  4. DO NOT CUT WRB AT CELLULOSE FILL HOLES
  5. STAPLE WRB LAP ALLOWANCE TO EXPOSED BATTENS AFTER SIDING

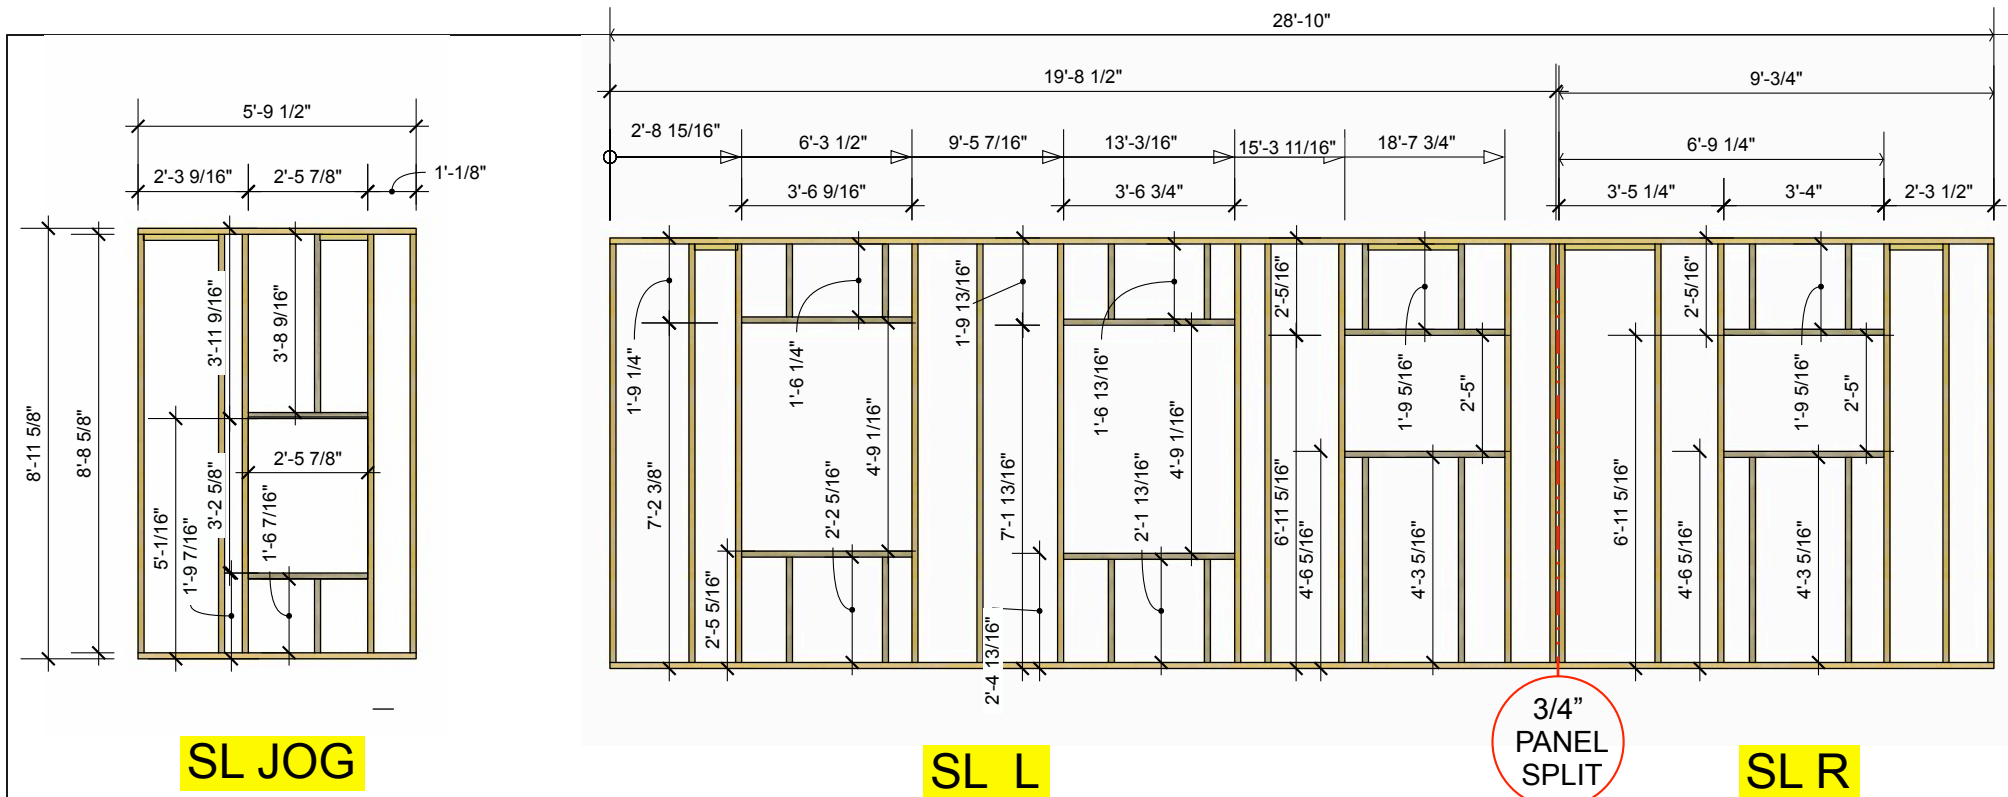

FRAME Scale: 1/4" = 1'-0"

- NOTES:
1. TOP AND BOTTOM PLATE OVER 14' TO BE LSL
  2. FRAMING LUMBER TO BE #1&2 SPF OR EQUIVALENT
  3. STUDS SPACED @ 24" O.C. UNLESS OTHERWISE NOTED

BUTTERWICK CONSTRUCTION  
& CARPENTRY LTD.  
5628 82 Ave  
Edmonton, AB T6B 3E6  
Tel: 780.434.3559  
www.butterwick.ca

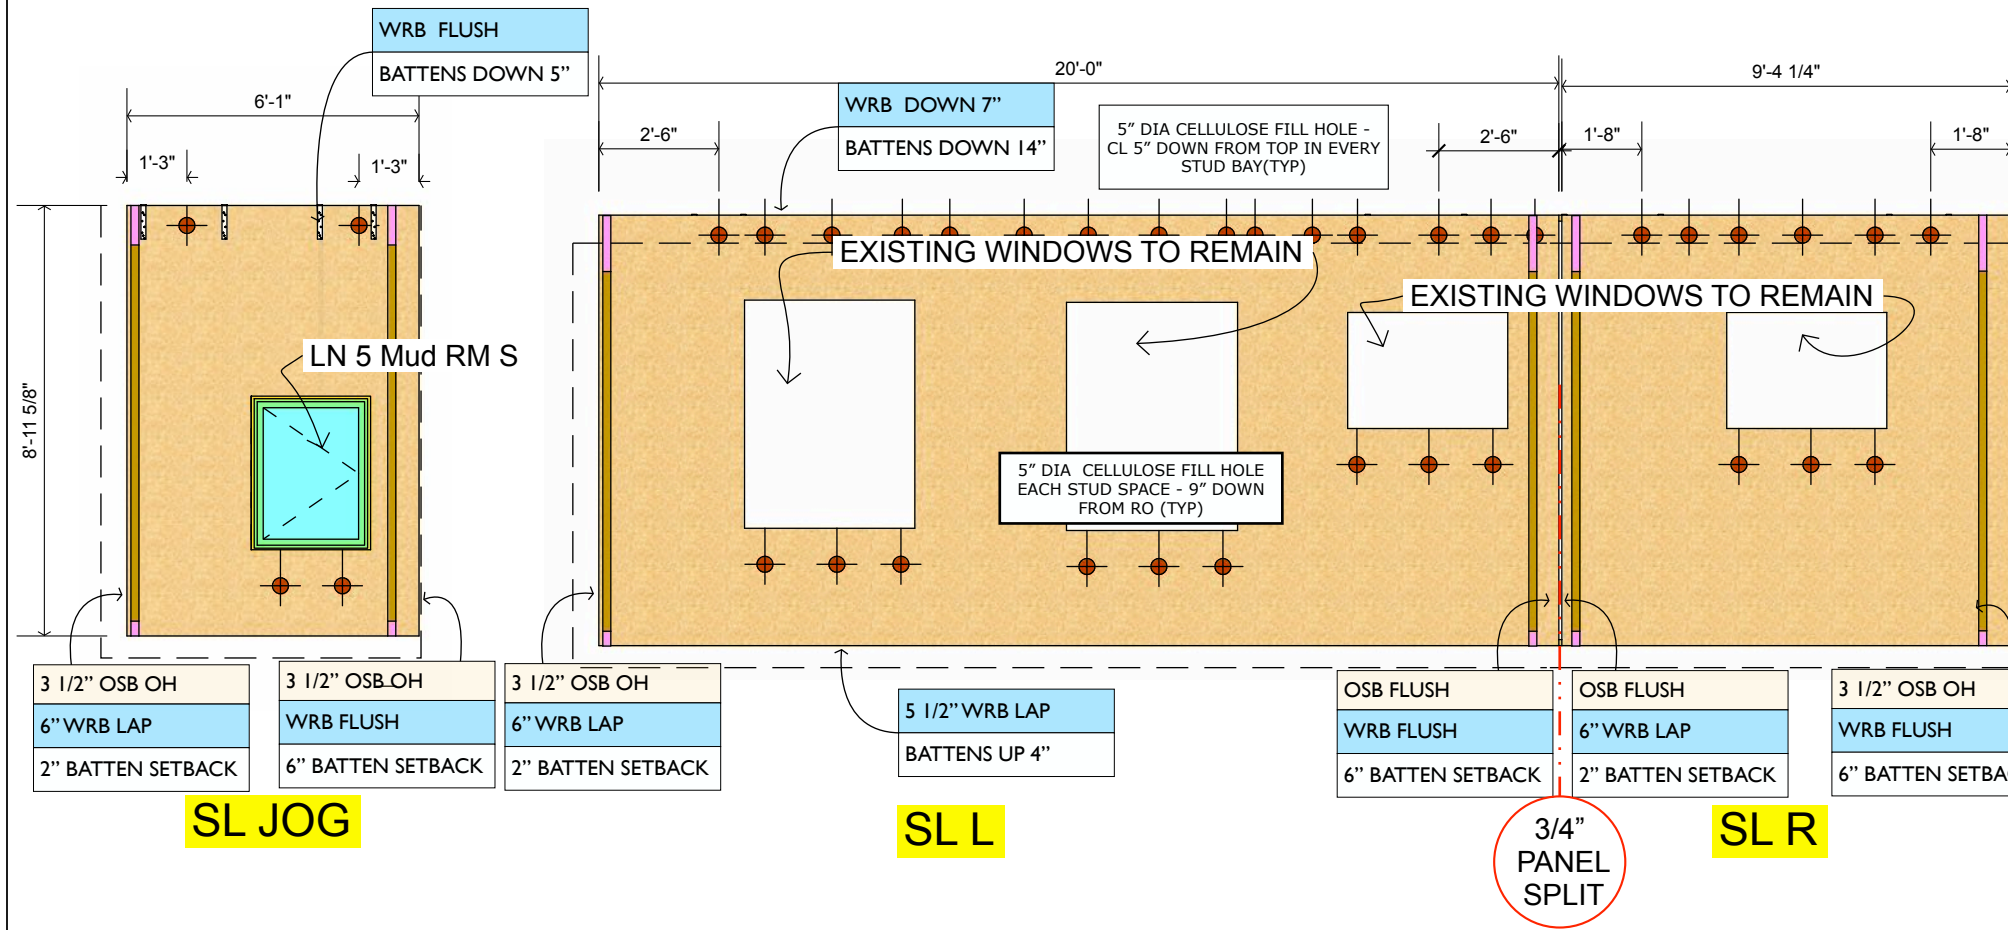

SHEATHING Scale: 1/4" = 1'-0"

- NOTES:
1. SHEATHING 7/16" OSB OR 1/2" SPRUCE PLYWOOD
  2. FLUSH SHEATHING ON ALL EDGES EXCEPT WHERE NOTED
  3. HORIZONTAL GAP BETWEEN SHEATHING SHEETS TO BE MIN 3/8" AND CAN BE UP TO 1 1/2"
  4. 5" DIA CELLULOSE FILL AND LIFT HOLES TO BE CENTRED 5" DOWN FROM TOP OF WALL AND 9" DOWN FROM RO SILL.

HIGHLANDS PANEL DRAWINGS

DATE  
June 3, 2022


FOR REVIEW

DRAWN BY  
PA, TA

WRB AND RAINDSCREEN BATTENS Scale: 1/4" = 1'-0"

- NOTES:
1. WRB TO BE SIGA MAJVEST SEALED PER 1.2 ON DETAIL SET
  2. BATTENS AS REQ'D FOR SIDING PER DETAIL SET
  3. DO NOT INSTALL BATTENS OVER LIFTING HOLES OR BLOWING HOLES
  4. DO NOT CUT WRB AT CELLULOSE FILL HOLES
  5. STAPLE WRB LAP ALLOWANCE TO EXPOSED BATTENS AFTER SIDING


SOUTH WALL

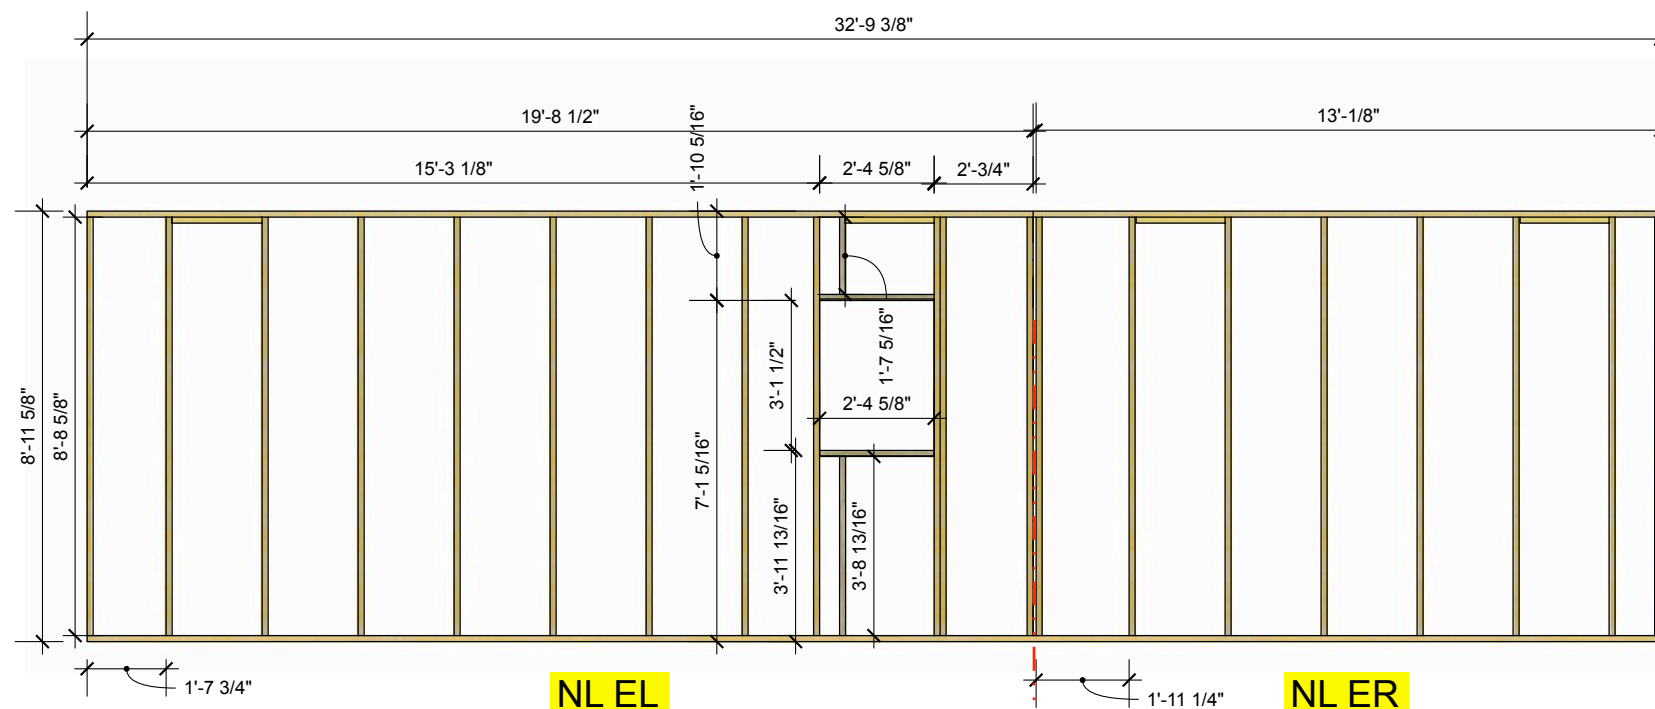

3/4" PANEL SPLIT

FRAME  
Scale: 1/4" = 1'-0"

- NOTES:
1. TOP AND BOTTOM PLATES OVER 14' TO BE LSL LUMBER
  2. ALL OTHER FRAMING LUMBER TO BE #1&2 SPF OR EQUIVALENT
  3. STUDS SPACED @ 24" O.C. UNLESS OTHERWISE NOTED

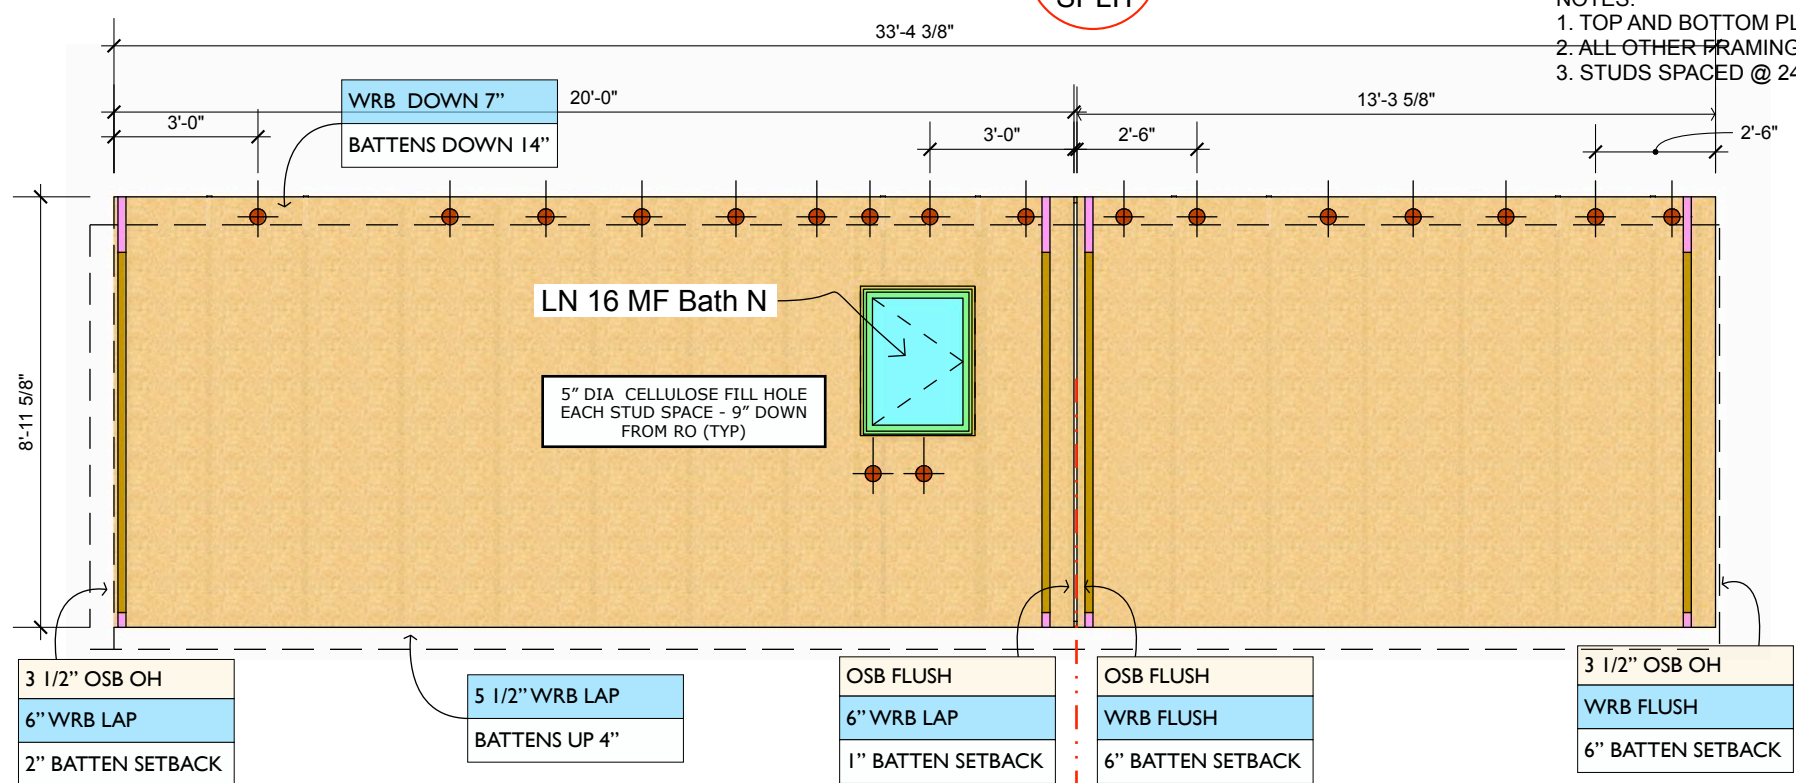

3/4" PANEL SPLIT

SHEATHING  
Scale: 1/4" = 1'-0"

- NOTES:
1. SHEATHING 7/16" OSB OR 1/2" SPRUCE PLYWOOD
  2. FLUSH SHEATHING ON ALL EDGES
  3. HORIZONTAL GAP BETWEEN SHEATHING SHEETS TO BE MIN 3/8" AND CAN BE UP TO 1 1/2"

WRB AND RAINSCREEN BATTENS  
Scale: 1/4" = 1'-0"

- NOTES:
1. WRB TO BE DELTA VENTS PLUS SEALED PER 1.2 ON DETAIL SET
  2. BATTENS AS REQ'D FOR SIDING PER DETAIL SET
  3. DO NOT INSTALL BATTENS OVER LIFTING HOLES OR BLOWING HOLES
  4. DO NOT CUT WRB AT CELLULOSE FILL HOLES
  5. STAPLE WRB LAP ALLOWANCE TO EXPOSED BATTENS AFTER SIDING

HIGHLANDS PANEL DRAWINGS

DATE  
June 3, 2022


FOR REVIEW

DRAWN BY  
PA, TA

NORTH WALL

FRAME  
Scale: 1/4" = 1'-0"

- NOTES:  
1. BOTTOM PLATES TO BE LSL LUMBER  
2. ALL OTHER FRAMING LUMBER TO BE #1&2 SPF OR EQUIVALENT  
3. STUDS SPACED @ 24" O.C. UNLESS OTHERWISE NOTED

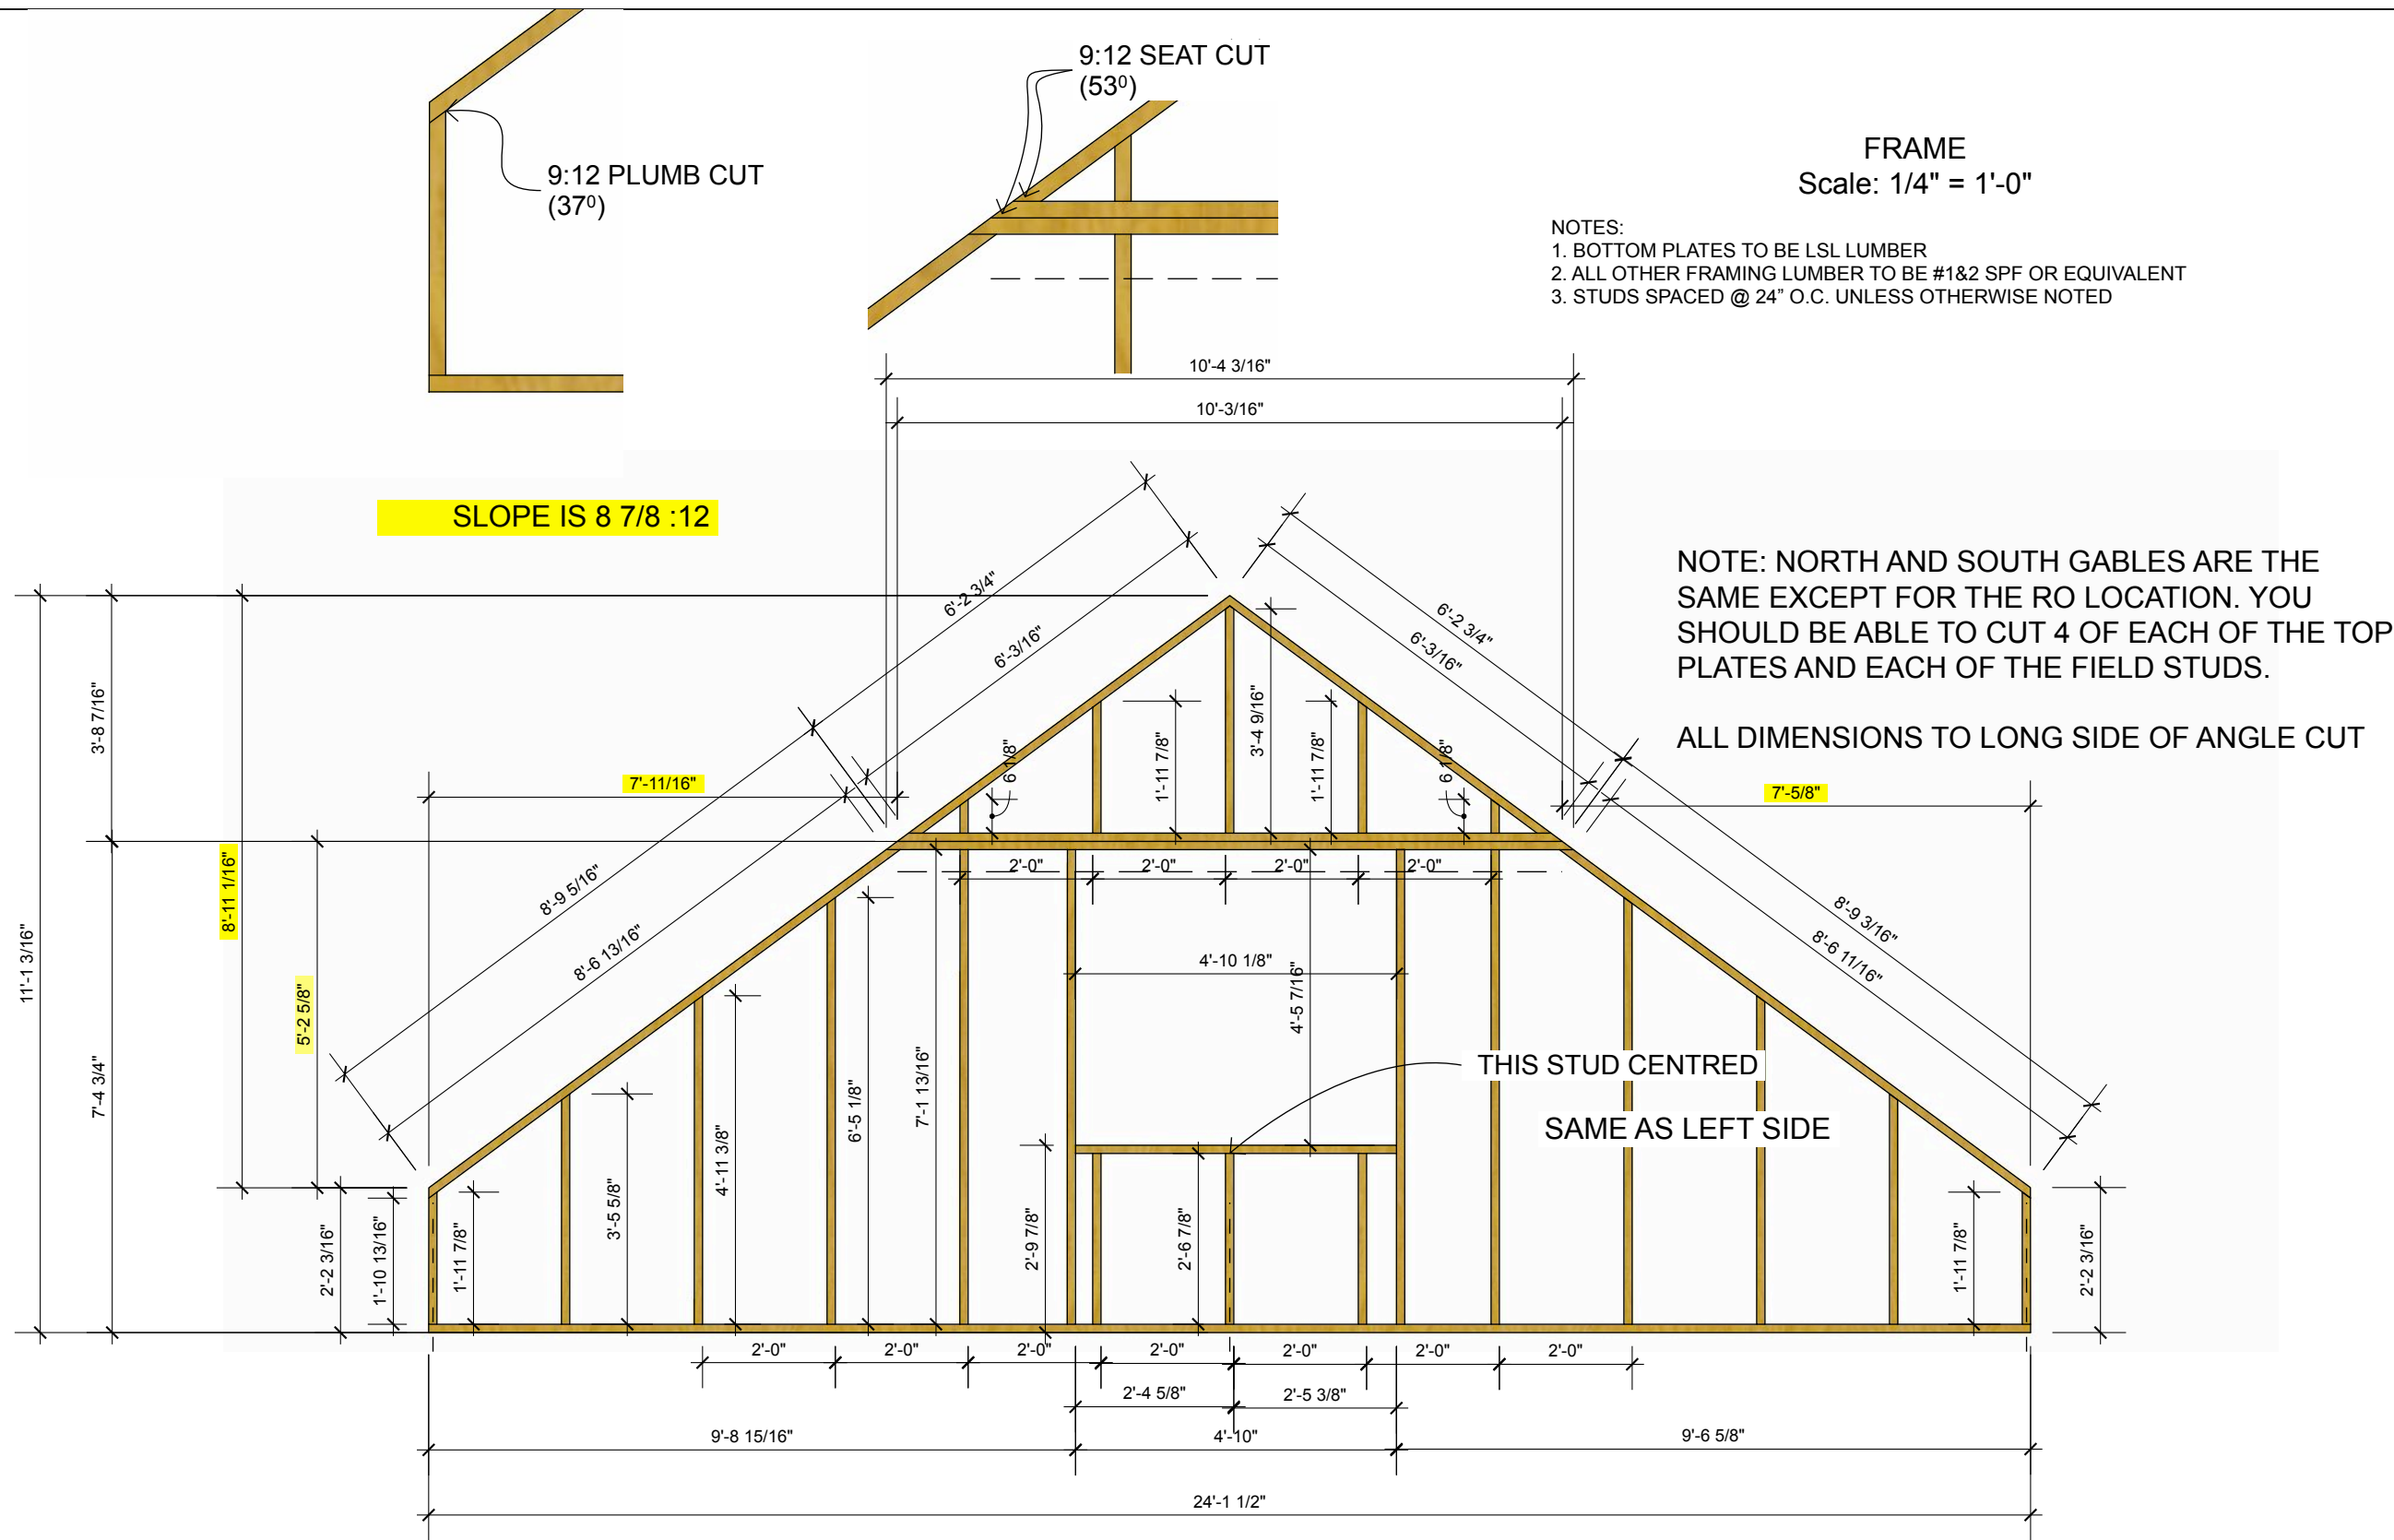

SLOPE IS 8 7/8 : 12

NOTE: NORTH AND SOUTH GABLES ARE THE SAME EXCEPT FOR THE RO LOCATION. YOU SHOULD BE ABLE TO CUT 4 OF EACH OF THE TOP PLATES AND EACH OF THE FIELD STUDS.

ALL DIMENSIONS TO LONG SIDE OF ANGLE CUT

THIS STUD CENTRED  
SAME AS LEFT SIDE

SOUTH GABLE :SU GABLE

HIGHLANDS PANEL  
DRAWINGS

DATE  
June 3, 2022

FOR REVIEW



DRAWN BY  
PA, TA

SOUTH GABLE



FRAME  
Scale: 1/4" = 1'-0"

- NOTES:  
1. BOTTOM PLATES TO BE LSL LUMBER  
2. ALL OTHER FRAMING LUMBER TO BE #1&2 SPF OR EQUIVALENT  
3. STUDS SPACED @ 24" O.C. UNLESS OTHERWISE NOTED

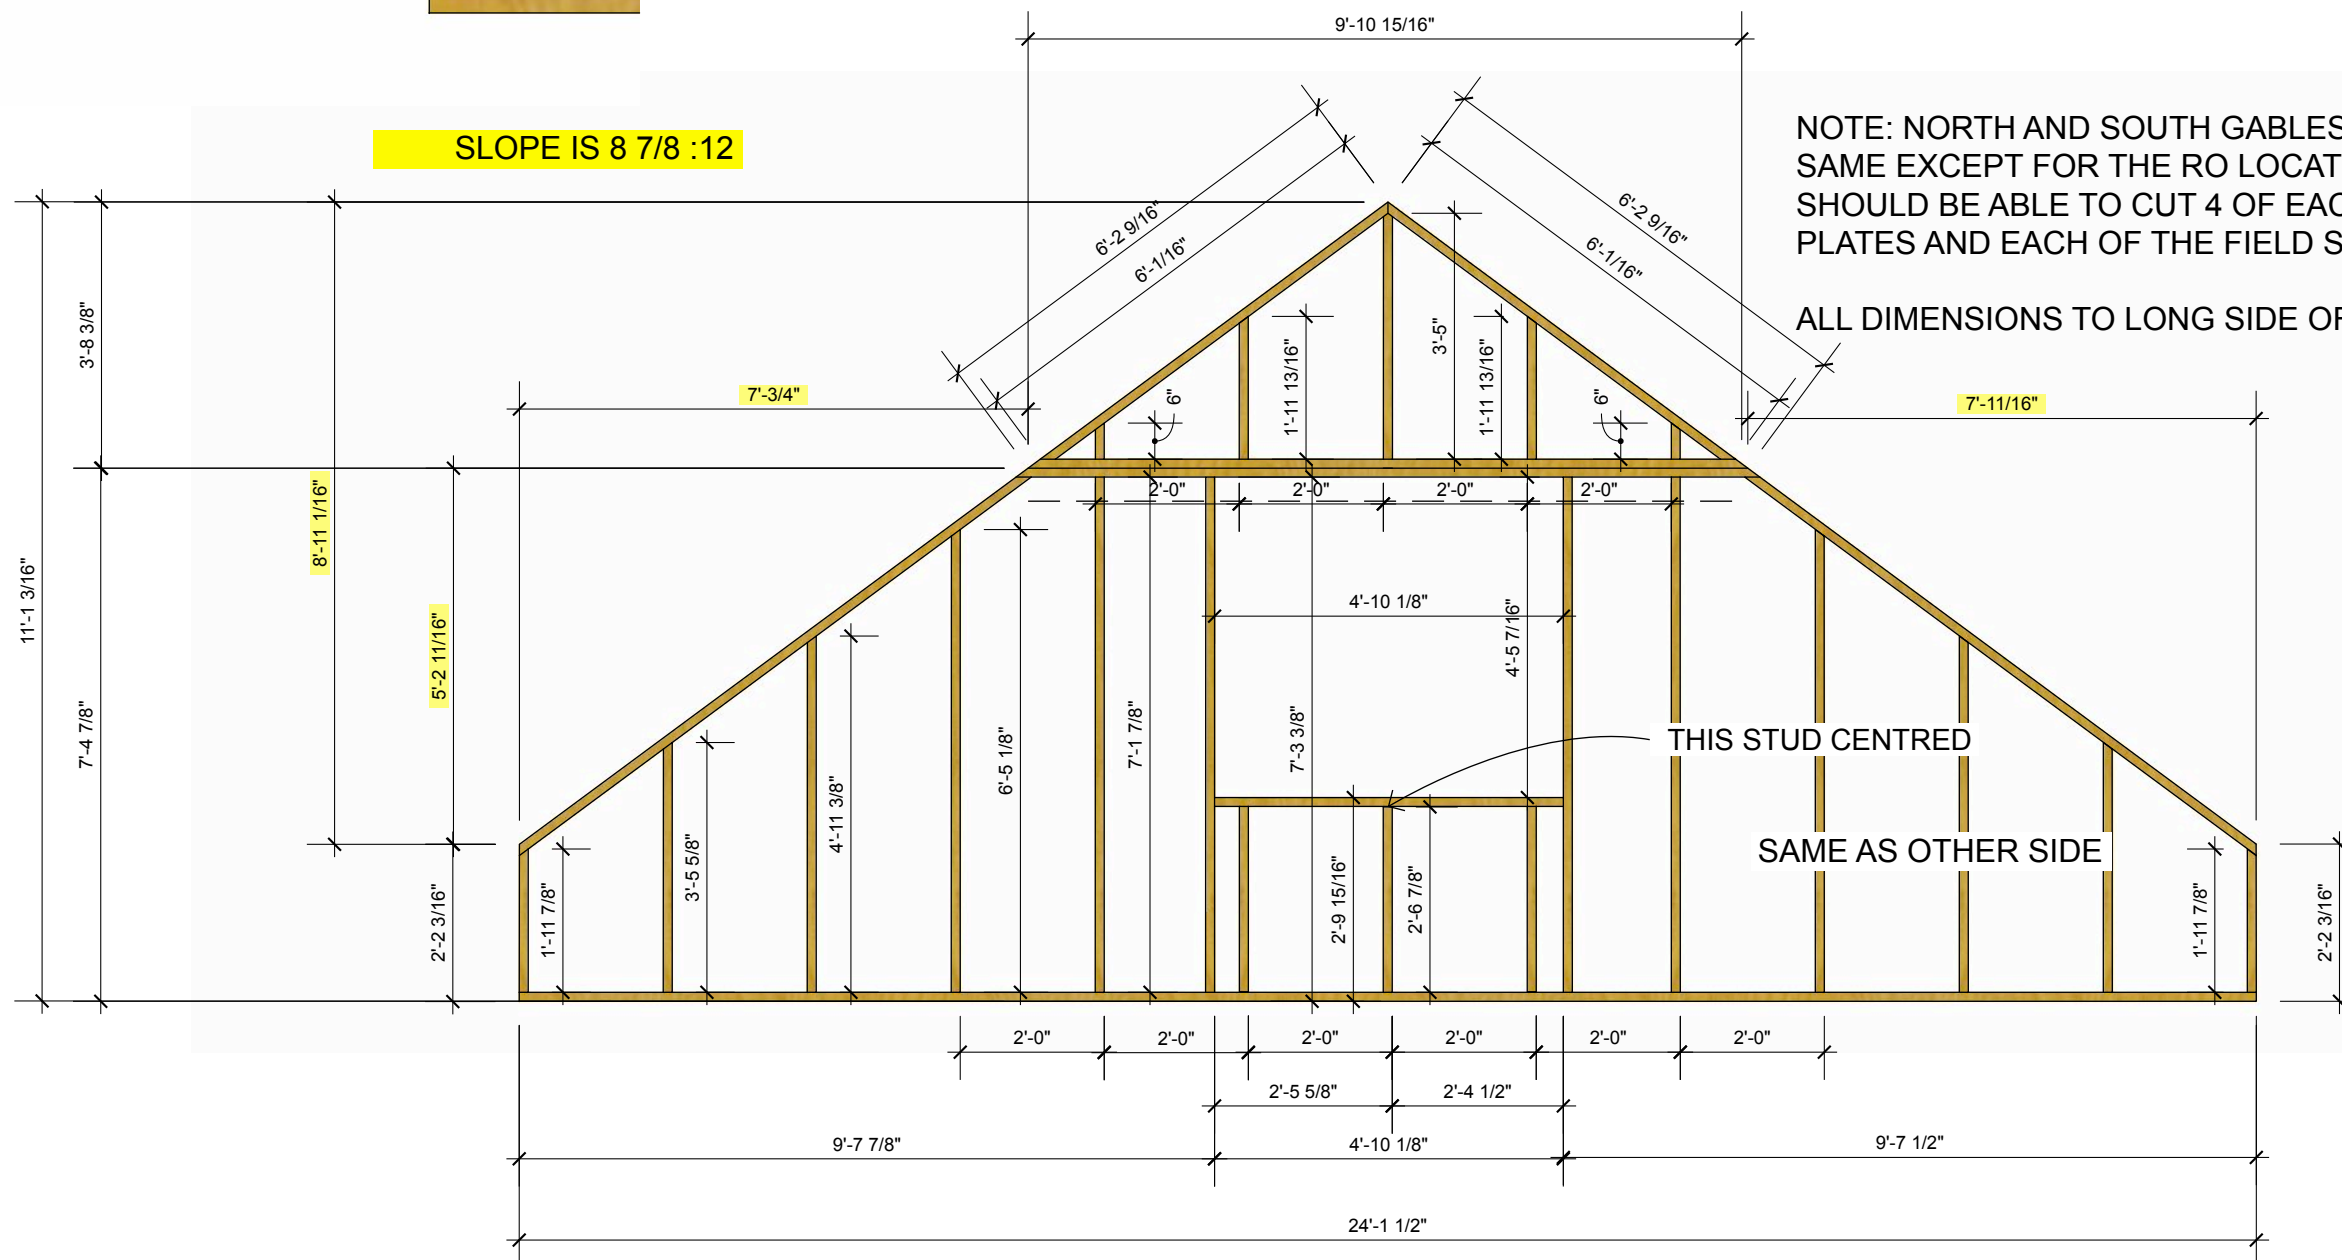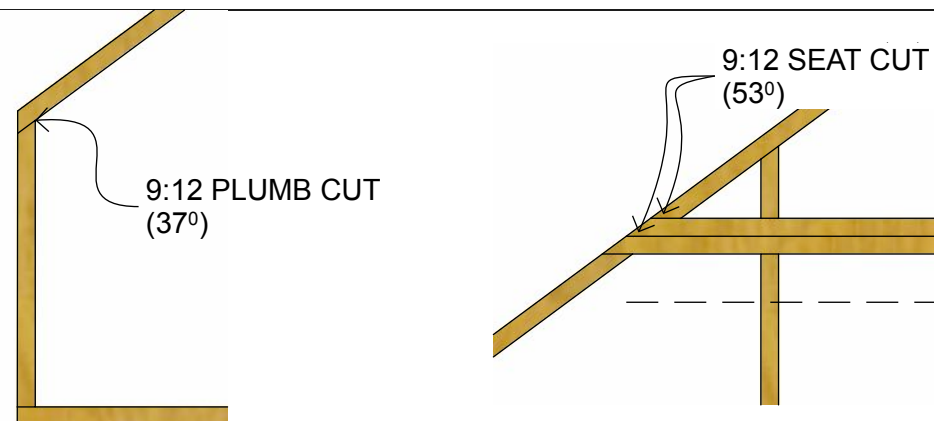

NOTE: NORTH AND SOUTH GABLES ARE THE SAME EXCEPT FOR THE RO LOCATION. YOU SHOULD BE ABLE TO CUT 4 OF EACH OF THE TOP PLATES AND EACH OF THE FIELD STUDS.

ALL DIMENSIONS TO LONG SIDE OF ANGLE CUT

SLOPE IS 8 7/8 : 12

NORTH GABLE :NU GABLE

HIGHLANDS PANEL  
DRAWINGS

DATE  
June 3, 2022

FOR REVIEW

DRAWN BY  
PA, TA


NORTH GABLE

FRAME  
Scale: 1/4" = 1'-0"

- NOTES:  
1. BOTTOM PLATES TO BE LSL LUMBER  
2. ALL OTHER FRAMING LUMBER TO BE #1&2 SPF OR EQUIVALENT  
3. STUDS SPACED @ 24" O.C. UNLESS OTHERWISE NOTED

SLOPE IS 8 3/4 :12

9:12 PLUMB CUTS (TYP)  
(37°)

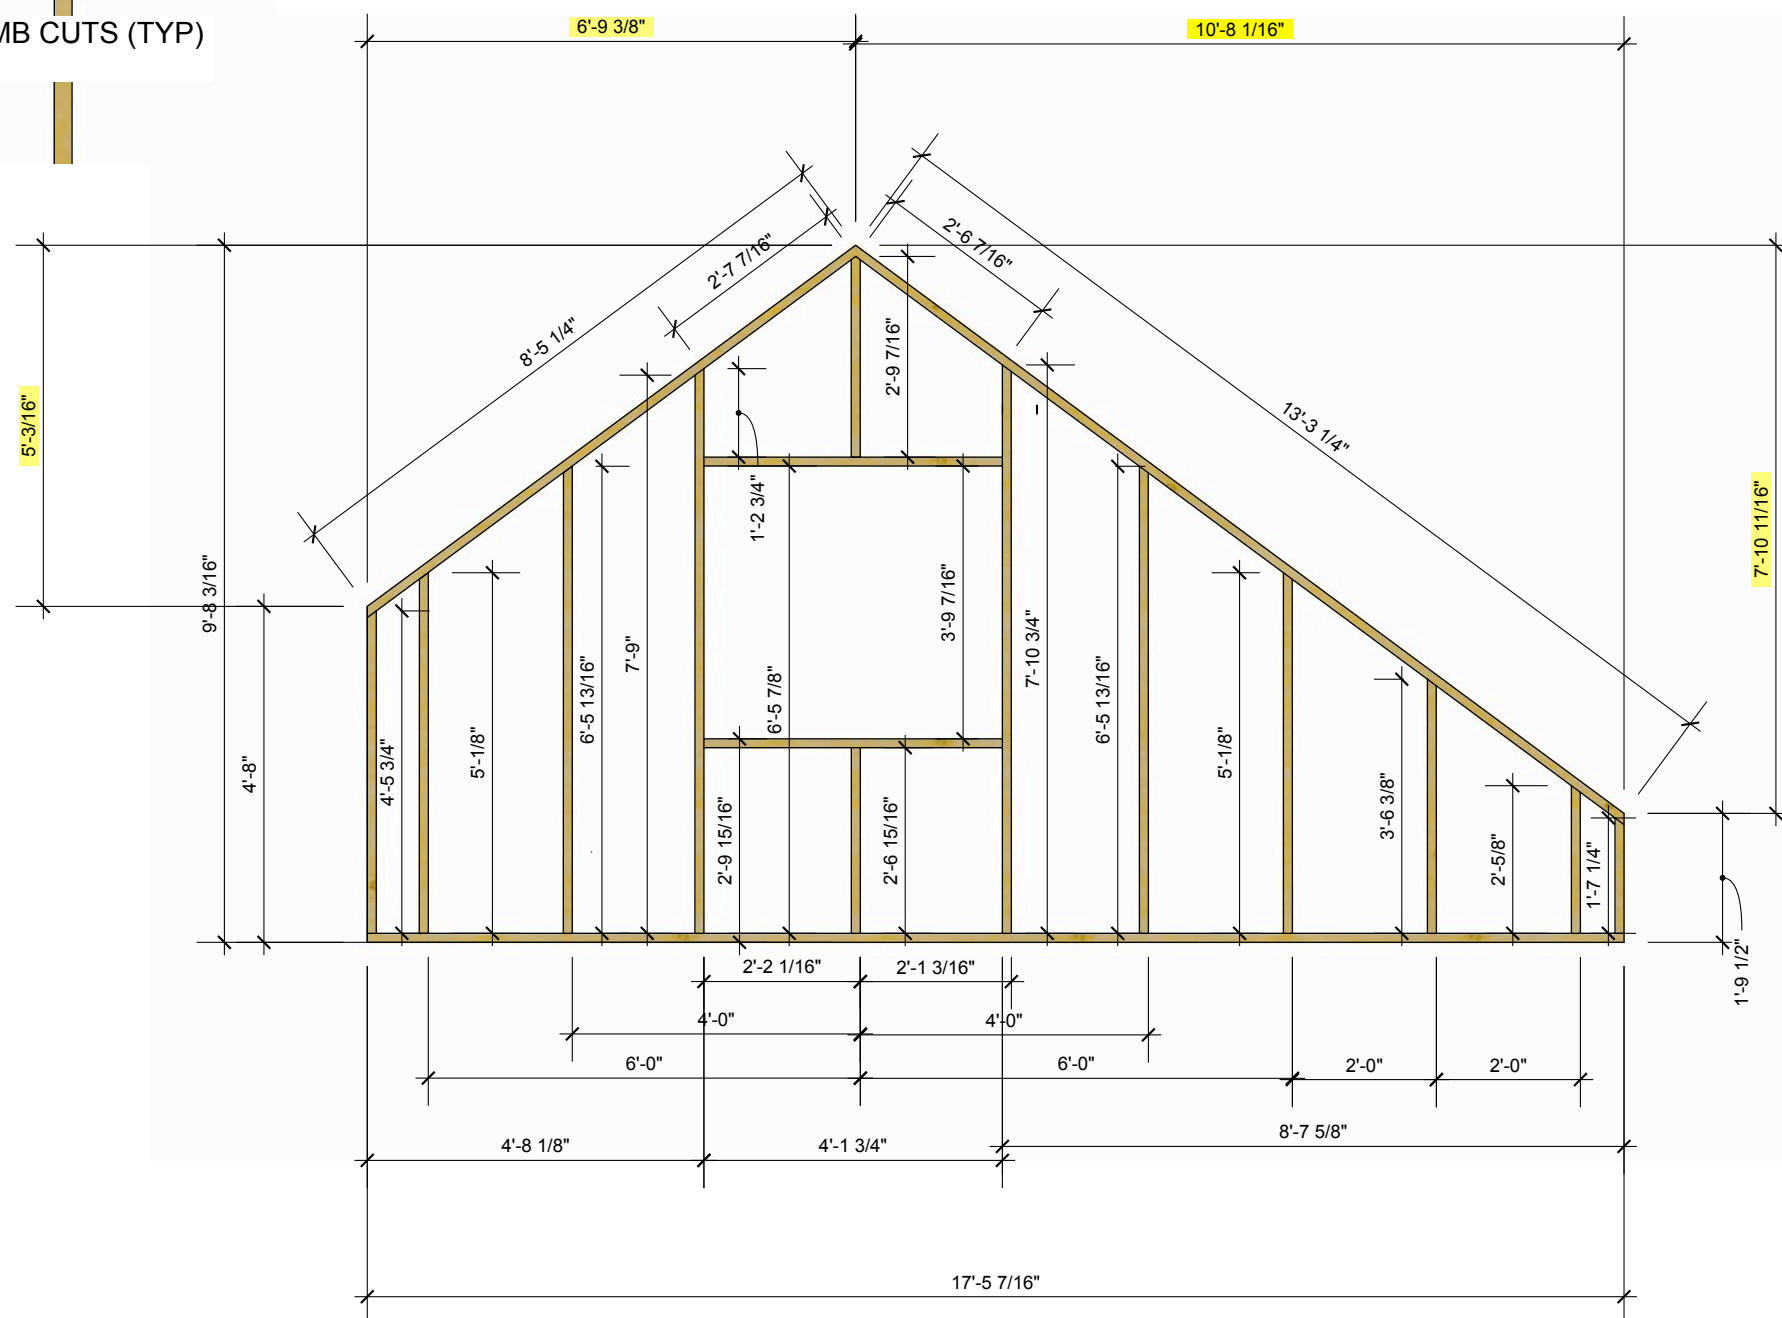

EAST GABLE :EU GABLE

HIGHLANDS PANEL  
DRAWINGS

DATE  
June 3, 2022

FOR REVIEW

DRAWN BY  
PA, TA


EAST GABLE

**SHEATHING**  
Scale: 1/4" = 1'-0"


- NOTES:
1. SHEATHING 7/16" OSB OR 1/2" SPRUCE PLYWOOD
  2. FLUSH SHEATHING ON ALL EDGES
  3. HORIZONTAL GAP BETWEEN SHEATHING SHEETS TO BE MIN 3/8" AND CAN BE UP TO 1 1/2"

**WRB AND RAINSCREEN BATTENS**  
Scale: 1/4" = 1'-0"

- NOTES:
1. WRB TO BE DELTA VENTS PLUS SEALED PER 1.2 ON DETAIL SET
  2. BATTENS AS REQ'D FOR SIDING PER DETAIL SET
  3. DO NOT INSTALL BATTENS OVER LIFTING HOLES OR BLOWING HOLES
  4. DO NOT CUT WRB AT CELLULOSE FILL HOLES
  5. STAPLE WRB LAP ALLOWANCE TO EXPOSED BATTENS AFTER SIDING

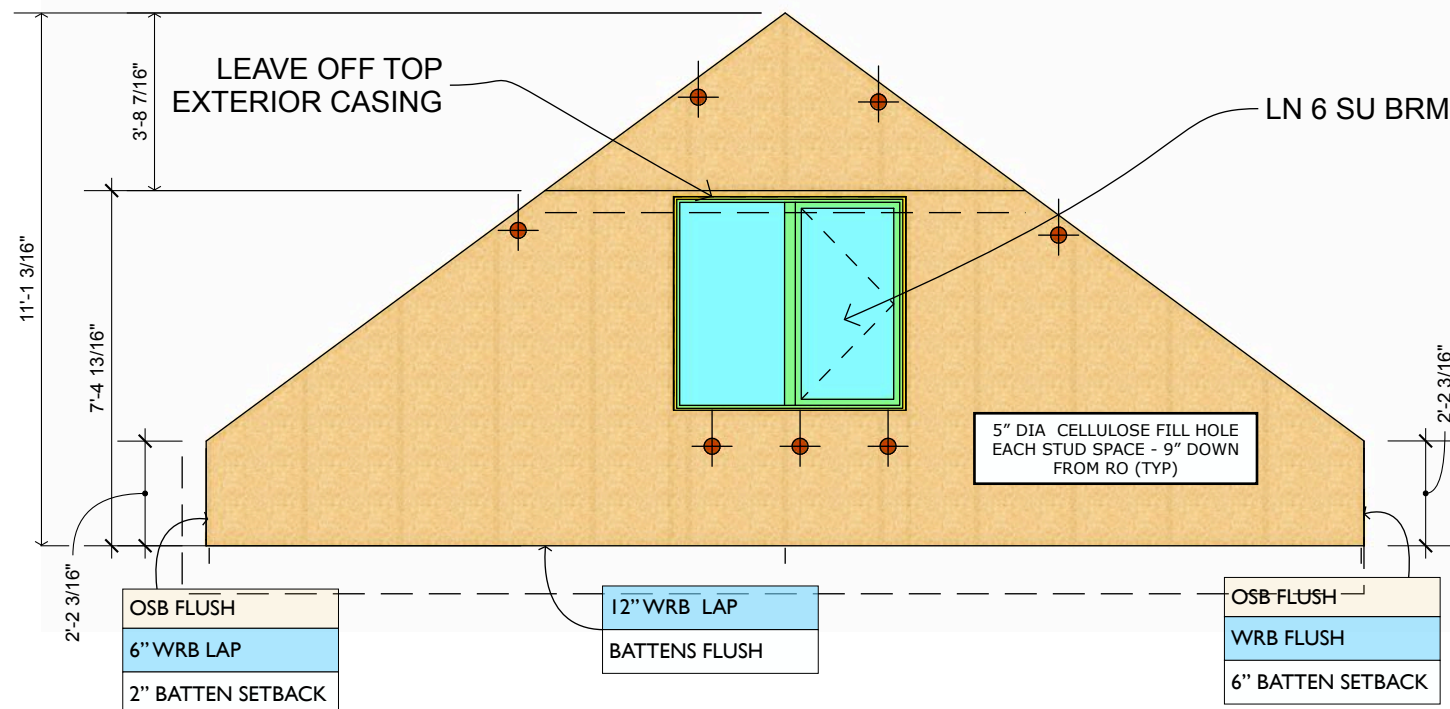

**SOUTH GABLE :SU GABLE**

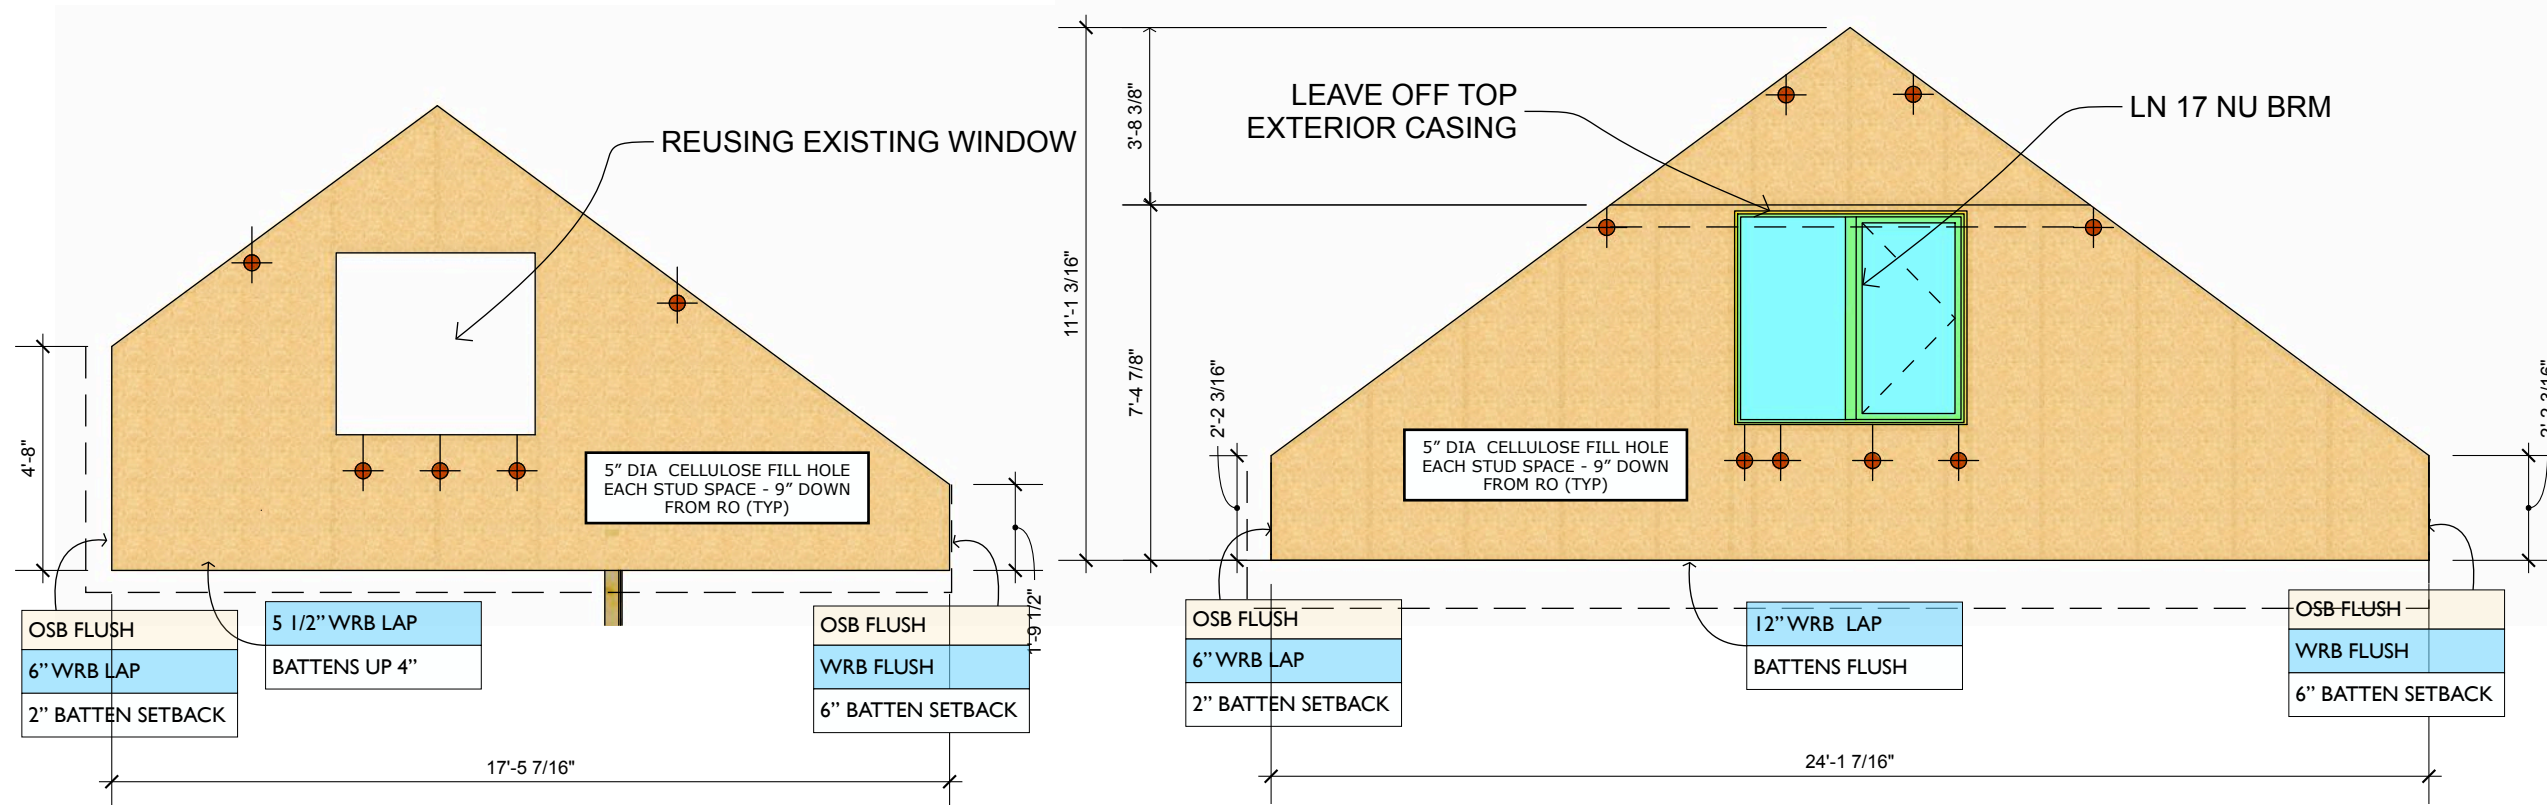

**EAST GABLE :EU GABLE**

**NORTH GABLE :NU GABLE**



**HIGHLANDS PANEL DRAWINGS**

DATE  
June 3, 2022


**FOR REVIEW**

DRAWN BY  
PA, TA

**GABLES - SHEATHING**

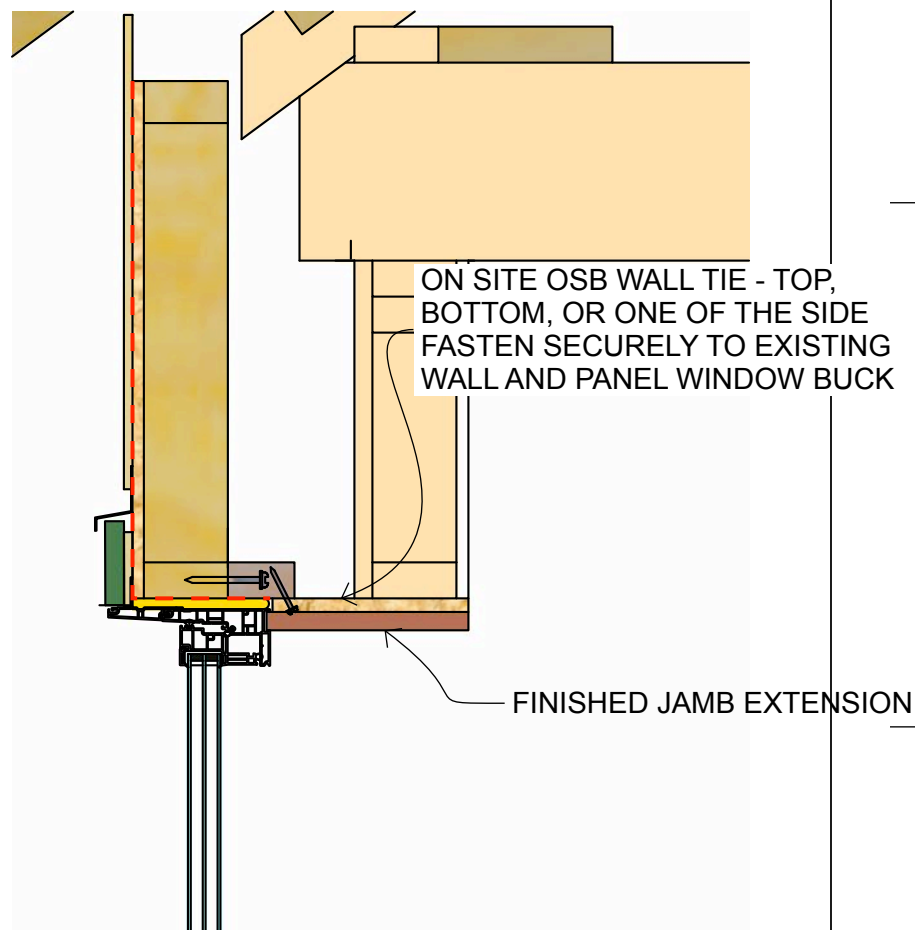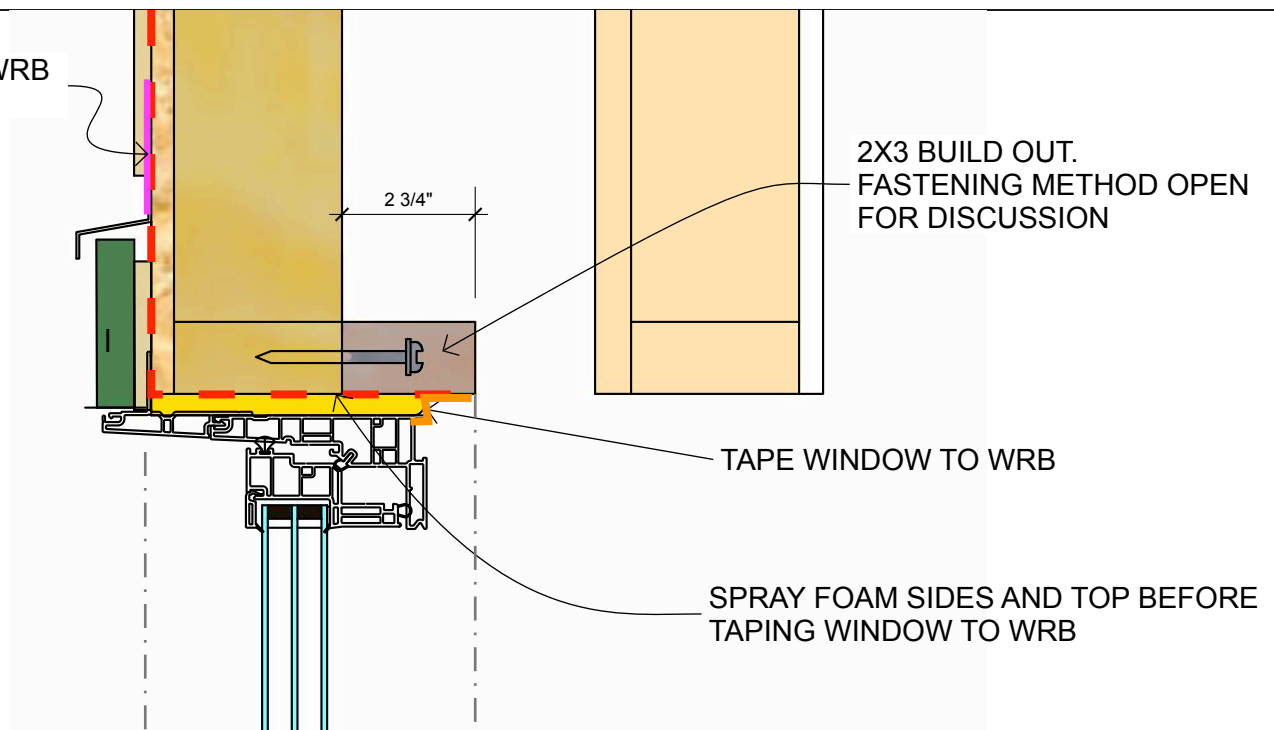

**TOP**

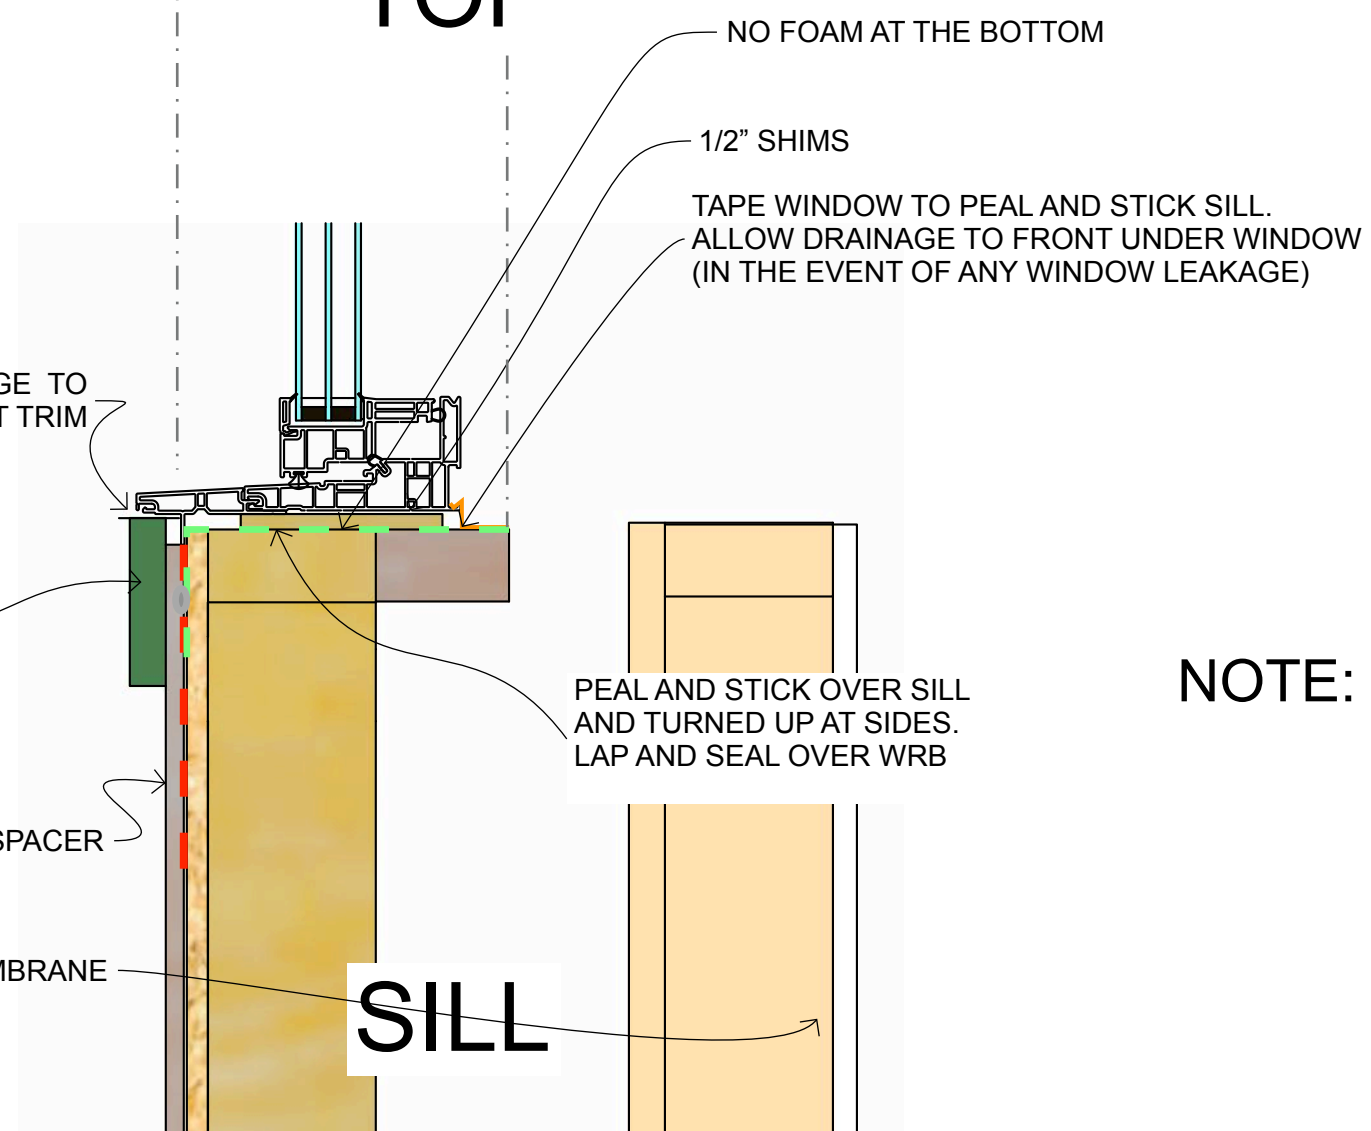

**NOTE: SIDES SAME AS TOP BUT W/O THE HEAD FLASHING**

**HIGHLANDS PANEL DRAWINGS**

DATE  
June 3, 2022

**FOR REVIEW**

DRAWN BY  
PA, TA

KOLHTECH WINDOW INSTAL