

ENGINEERING DATA

THERMALLY CONDUCTIVE, PATENTED ALUMINUM CORE

The counter-flow heat recovery core transfers heat between the two airstreams. It is easily removed for cleaning or service.

MOTORS AND BLOWERS

Each airstream has an independent motorized impeller with multiple fan speed operations.

FILTERS

Washable air filters in exhaust and supply airstream.

MOUNTING THE HRV

Threaded inserts at corners of the cabinet designed to accept the "S" hooks and hanging straps supplied with the unit.

DEFROST

Recirculating damper defrost system.

CASE

20 gauge prepainted galvanized steel for superior corrosion resistance, insulated to prevent exterior condensation. Drain connection: Two 1/2 in (12 mm) OD. Balancing ports are located on unit.

INSTALLER SELECTABLE HIGH SPEED SETTINGS

Adjustable DIP switches are located on the circuit board, Hi3 is the factory setting. Refer to the Installation manual for the adjustment instructions.

ELECTRONICS

The optional controls can be wall mounted in a central location of the home. 3 wire 20 gauge (min.) 100 ft length (max.).

CONTROL OPTIONS

99-GDXPL02 Airflow Digital Control

- 5 speed operation on each mode
- Humidity control through adjustable Dehumidistat
- 5 user selectable operational modes: Continuous Ventilation, Continuous Recirculation, 20 ON/40 OFF, 10 ON/50 OFF, 20 ON/40 Recirculation
- 20/40/60 min. High speed override button
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-GBC02 Airflow Ventilation Control

- 2 speed fan setting (Low/High)
- Humidity control through adjustable Dehumidistat
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-GBC03 Airflow Ventilation Control

- Continuous Low fan speed
- Humidity control through adjustable Dehumidistat
- 3 modes of operation: Ventilation, Recirculation, 20/40
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-GBC04 Airflow Ventilation Control

- 2 speed fan setting (Low/High)
- 2 modes of operation: Ventilation, 20/40
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-GDH01 Airflow Dehumidistat

- Humidity control through adjustable Dehumidistat
- 3 wire connection

TIMER OPTIONS

99-DET01 Airflow 20/40/60 Minute Timer - Initiates High speed Ventilation for 20, 40 or 60 minutes. 3 wire connection.

99-DET02 Airflow WIRELESS 20/40/60 Minute Timer - Initiates High speed Ventilation for 20, 40 or 60 minutes. Wirelessly connects to main control for ease of installation. 40' approximate range.

99-RX02 Airflow WIRELESS Repeater - Used to extend range of 99-DET02 Wireless Timers. Plugs into 120V power outlet. Wirelessly connects to main control and 99-DET02. Install at halfway point between timer and main wall control if timer is out of range.


ACCESSORY OPTIONS

99-163 Duct Heater w/Electronic SCR Thermostat - 1 kW, 6 in (152 mm)

99-186 Weatherhoods - Two 6 in (152 mm)

DIMENSIONS AIR205R

WEIGHT 57 lbs (25.8 kg) **SHIPPING WEIGHT** 67 lbs (30 kg)

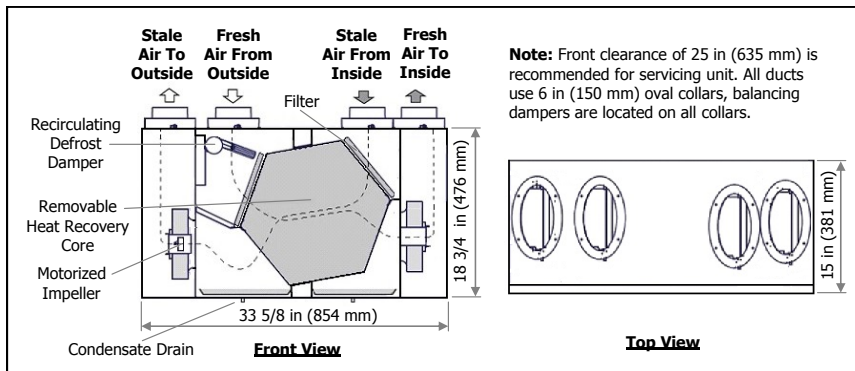


Performance (HVI certified) Net supply air flow in cfm (L/s) against external static pressure		
External Static Pressure	Airflow	
@ 0.1 in (25 Pa)	203 cfm (96 L/s)	
@ 0.2 in (50 Pa)	193 cfm (91 L/s)	
@ 0.3 in (75 Pa)	183 cfm (86 L/s)	
@ 0.4 in (100 Pa)	171 cfm (81 L/s)	
@ 0.5 in (125 Pa)	160 cfm (75 L/s)	
@ 0.6 in (150 Pa)	148 cfm (70 L/s)	
@ 0.7 in (175 Pa)	135 cfm (64 L/s)	
@ 0.8 in (200 Pa)	121 cfm (57 L/s)	
@ 0.9 in (225 Pa)	107 cfm (51 L/s)	
@ 1.0 in (250 Pa)	93 cfm (44 L/s)	
Max. Temperature Recovery	85%	
Sensible Effectiveness		
@ 64 cfm (30 L/s)	32°F (0°C)	85%
Sensible Efficiency		
@ 64 cfm (30 L/s)	32°F (0°C)	71%
Sensible Efficiency		
@ 100 cfm (47 L/s)	-13°F (-25°C)	68%
VAC @ 60Hz	120	
Watts / Low speed	64	
Watts / High speed	96	
Amp rating	1.4	

Sensible Efficiency: Thermal

Effectiveness: Based on temperature differential between the 2 airstreams

Efficiency: Takes into account all power inputs

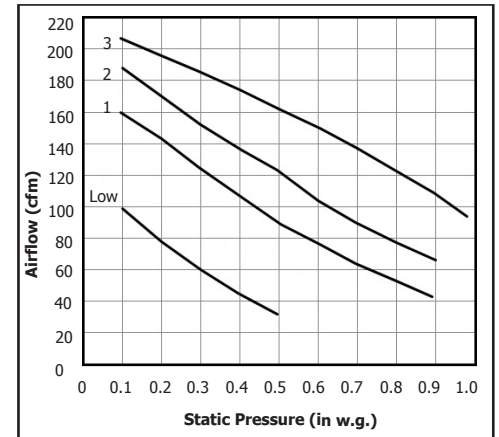

WARRANTY

Units carry a lifetime warranty on the HRV core and a 5 year replacement parts warranty.

NOTE: All specifications are subject to change without notice.

All units conform to CSA and UL standards



Date: _____
 Tag: _____ Qty: _____
 Project: _____
 Engineer: _____

Contractor: _____
 Supplier: _____
 Quote #: _____
 Submitted By: _____